



**DANE COUNTY DEPT. OF
PUBLIC WORKS, HIGHWAY &
TRANSPORTATION**

1919 Alliant Energy Center Way
Madison, Wisconsin 53713
Office: 608/266-4018 ♦ Fax: 608/267-1533
Public Works Engineering Division

ADDENDUM 1

August 15, 2019

ATTENTION ALL REQUEST FOR BID (RFB) HOLDERS

RFB NO. 318061 - ADDENDUM NO. 1

YAHARA RIVER FLOW ENHANCEMENT

BIDS DUE: TUESDAY, AUGUST 27, 2019, 2:00 PM. DUE DATE AND
TIME ARE NOT CHANGED BY THIS ADDENDUM.

This Addendum is issued to modify, explain or clarify the original Request for Bid (RFB) and is hereby made a part of the RFB. Please attach this Addendum to the RFB.

PLEASE MAKE THE FOLLOWING CHANGES:

1. Section 02225-Hydraulic Dredging for Sediment Removal

Section Title: 1.3 Submittals, A. 2.e.

Change:

Provide piping with a minimum pressure rating equal to twice the maximum total dynamic head of the pumps included in the pumping system., to: "Provide piping with a minimum pressure rating that shall be greater than the maximum total dynamic head of the pumps included in the pumping system"

2. Sheet "Boat Launch Locations"

Add new Sheet "Boat Launch Locations", issued with this Addendum.

3. Sheet 3 of 4 - Profile

Delete current Sheet 3 - Profile; replace with new Sheet 3 - Profile, issued with this Addendum.

PLEASE NOTE THE FOLLOWING CONTRACTOR SUBMITTED QUESTIONS:

Question 1:

Requesting the County extend the final completion date to Sept 30th, 2020 for the project.

Response 1:

Dredging in the river shall be complete by June 30, 2020. Remainder of work to remove pipelines, pumps, and restoration of the dewatering site shall be completed by October 1, 2020.

Question 2:

Page 0225-2 , item e states that the min. pressure rating of the pipe be twice the max. dynamic head. HDPE minimum pipe ratings already have a safety factor built in. This clause doubles up on this safety factor.

Response 2:

Statement changed to: "Provide piping with a minimum pressure rating that shall be greater than the maximum total dynamic head of the pumps included in the pumping system"

Question 3:

Is there a designated staging area for fusing pipe and launching equipment?

Response 3:

A map has been provided to show boat launch locations.

Question 4:

Page 104 of the Specifications shows the profile of the sediment and design grade. There is no indication of the normal pool level. This information is important in order to determine the required draft of the hydraulic dredge. Could you please provide this information?

Response 4:

The plan sheet has been updated to show water levels of summer maximum, summer minimum, and current water levels.

If any additional information about this Addendum is needed, please call Ryan Shore at 608/266-4475, shore@countyofdane.com.

Sincerely,




Project Manager

Enclosures:

Boat Launch Locations
Sheet 3 of 4 - Profile



YAHARA RIVER EXISTING & PROPOSED CHANNEL BOTTOM PROFILE

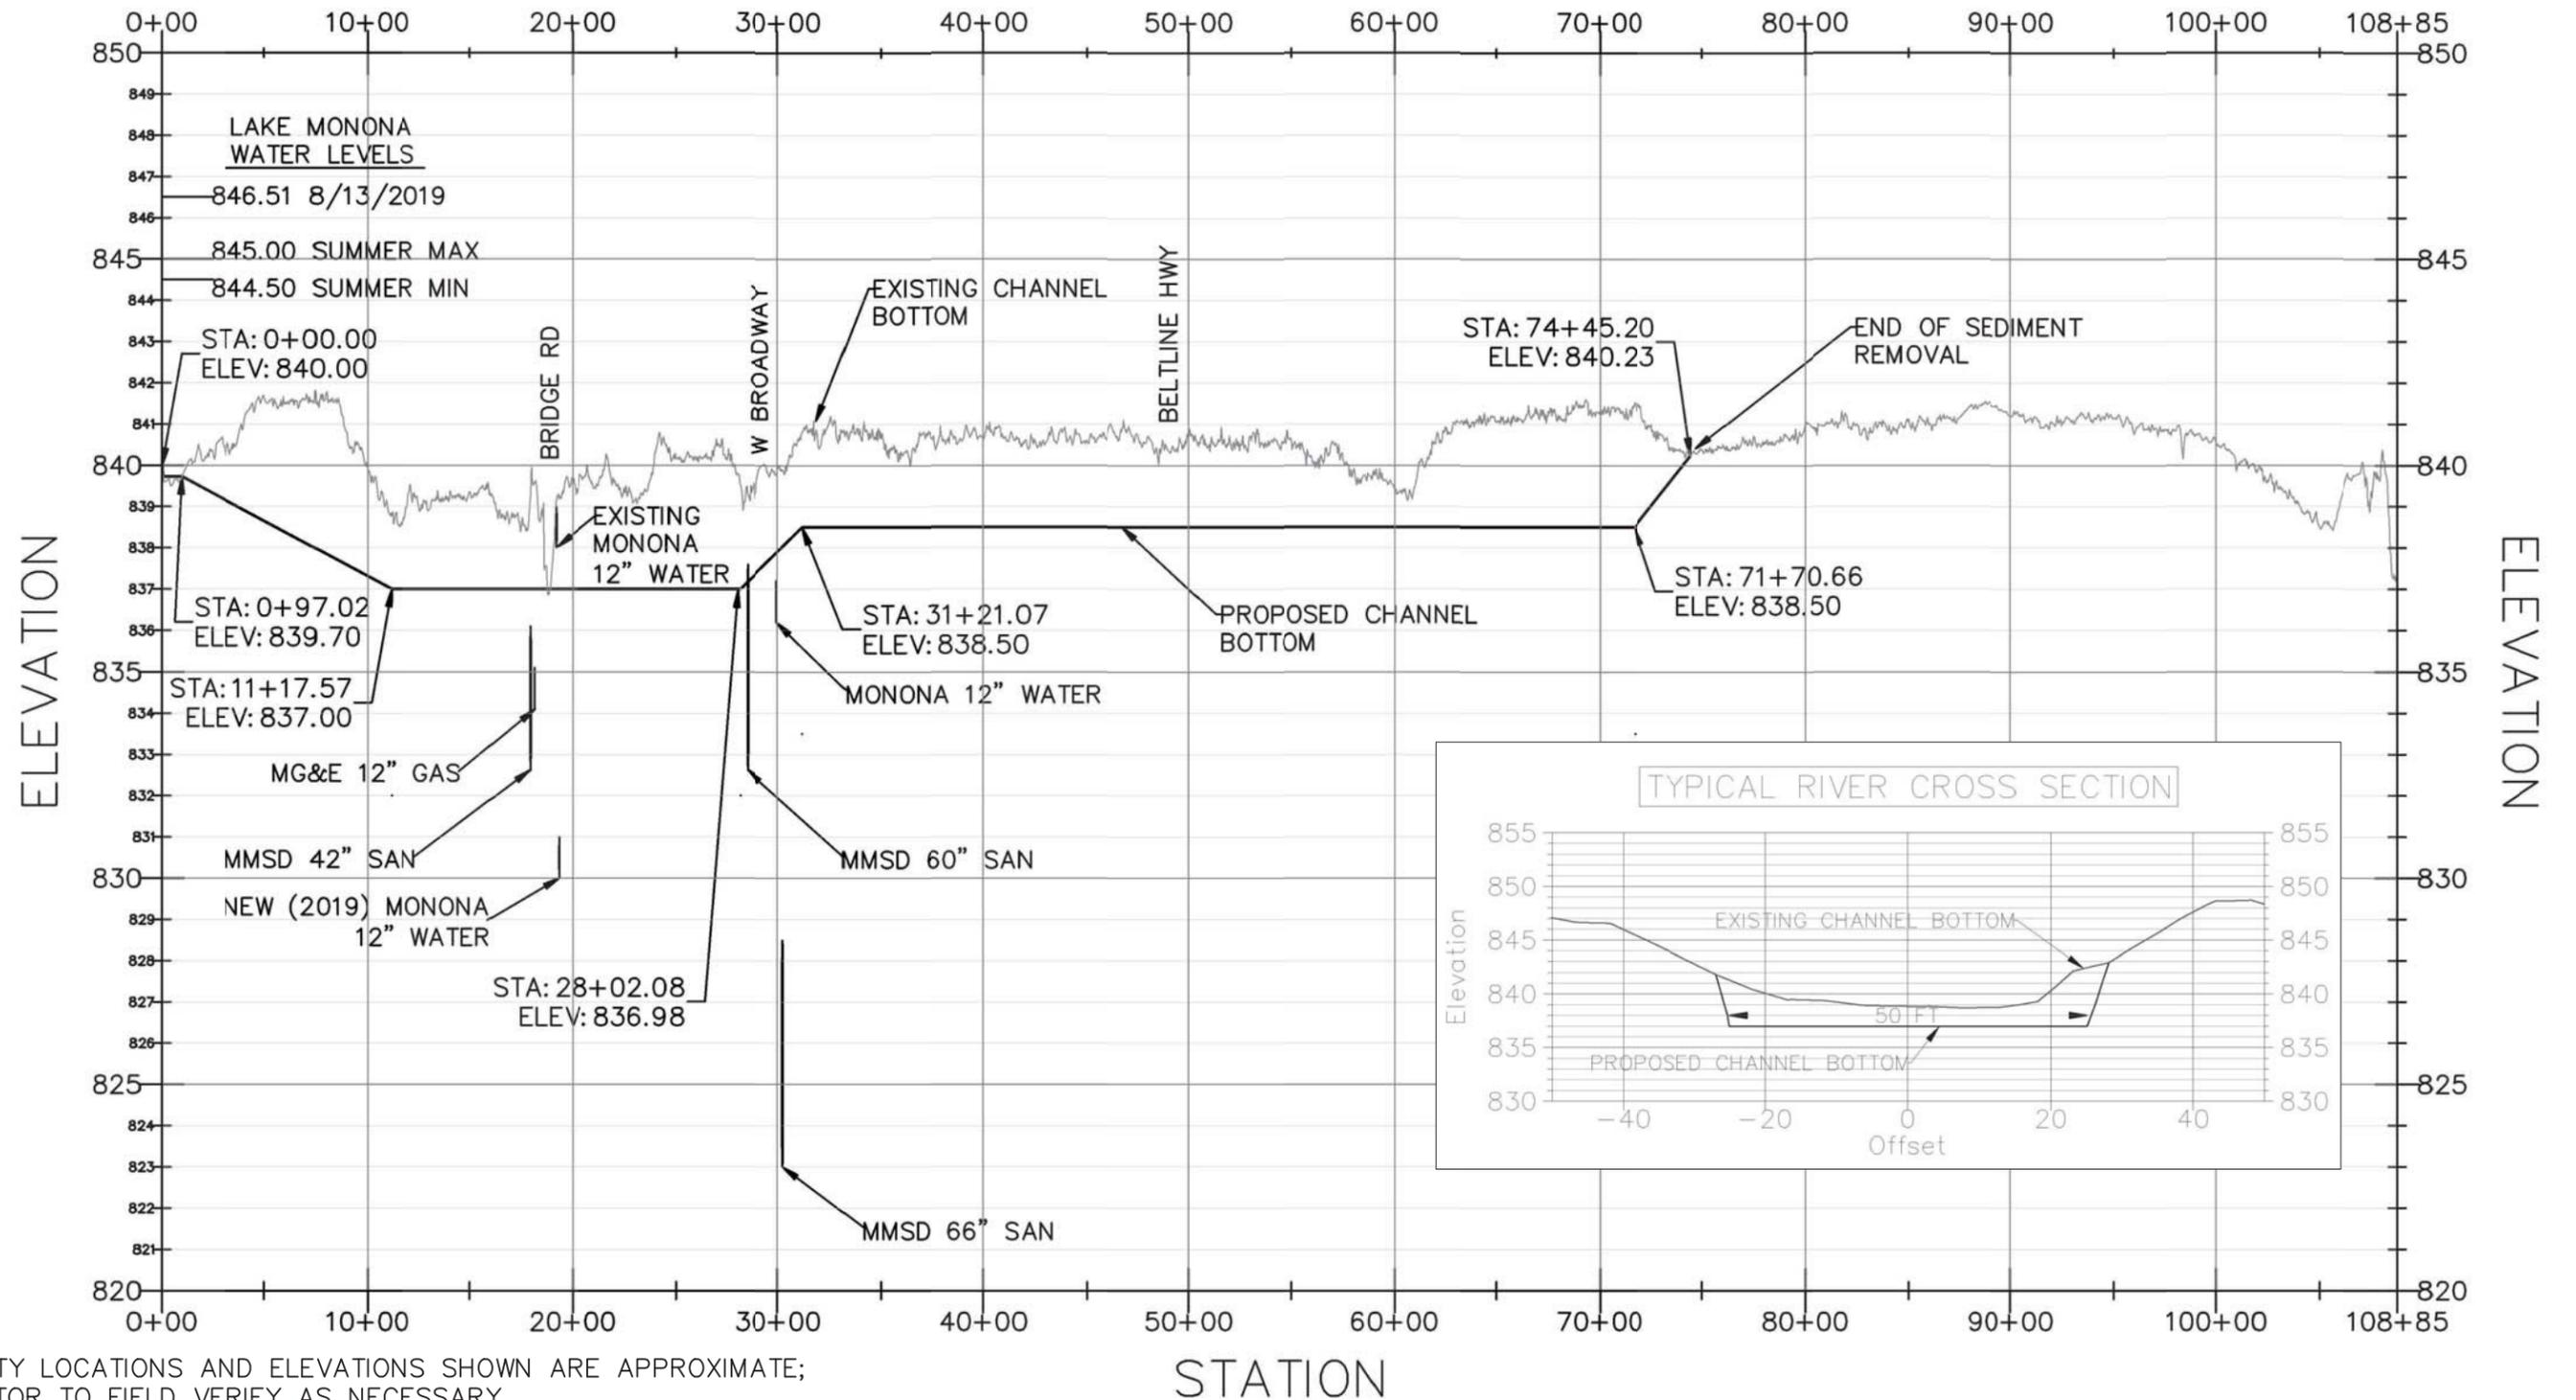

ALL UTILITY LOCATIONS AND ELEVATIONS SHOWN ARE APPROXIMATE;
 CONTRACTOR TO FIELD VERIFY AS NECESSARY.
 CONTACT MG&E WHEN WORKING NEAR GAS LINE.

VERTICAL DATUM NAVD88

YAHARA RIVER SEDIMENT REMOVAL PROJECT LAKE MONONA TO LAKE WAUBESA PROFILE



DRAWN BY: TMN DATE: 08/13/19
 CHECKED BY: JDB DATE: 08/13/19
 APPROVED BY: JRR DATE: 08/13/19
 SHEET: 3 of 4