

November 19, 2013

ATTENTION ALL REQUEST FOR BID (RFB) HOLDERS

RFB NO. 313072- REBID- ADDENDUM NO. 3

ALLIANT ENERGY CENTER PAVILIONS

BIDS DUE: THURSDAY, NOVEMBER 21, 2013, 2:00 PM. DUE DATE AND TIME ARE NOT CHANGED BY THIS ADDENDUM.

This Addendum is issued to modify, explain or clarify the original Request for Bid (RFB) and is hereby made a part of the RFB. Please attach this Addendum to the RFB. **Bidders must acknowledge all Addenda on the Bid Form.**

PLEASE MAKE THE FOLLOWING CHANGES:

1. Addendum 2

Under the list of Enclosures, add Sheets A001 and A807 to the list, and delete Sheets E201A and EP202A from the list.

2. Sheet FP201A

Delete current Sheet FP201A; replace with new Sheet FP201A, issued with this Addendum. Revised Fire Protection classification.

3. Sheet FP201B

Delete current Sheet FP201B; replace with new Sheet FP201B, issued with this Addendum. Revised Fire Protection classification.

4. Sheet FP201C

Delete current Sheet FP201C; replace with new Sheet FP201C, issued with this Addendum. Revised Fire Protection classification.

5. Sheet FP201D

Delete current Sheet FP201D; replace with new Sheet FP201D, issued with this Addendum. Revised Fire Protection classification.

Enclosures:

Sheets FP201A, FP201B, FP201C, FP201D, all 30"x42" dated 11-18-13.

Addendum No. 3

RFB No. 313072-REBID

- 1 of 1 -

Addendum 3.doc

FIRE PROTECTION NOTES

LIGHT HAZARD
FIRE PROTECTION REQUIREMENTS

NOTE:
AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "LIGHT HAZARD" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR OFFICE AND MEETING ROOM AREAS)

WET PIPE SYSTEM

1. LIGHT HAZARD PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 225 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A WET PIPE SYSTEM.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS.
5. SPRINKLERS IN OFFICE AND SUPPORT SPACES WITH A TEMPERATURE RATING OF 165°F DENSITY OF 0.10 GPM/SQ.FT.
6. SPRINKLER HEADS TO BE CONCEALED WITH WHITE COVER PLATE IN FINISHED SPACES. UPRIGHT BRASS IN UNFINISHED SPACES, AND PAINTED IN TO MATCH CEILING IN SANCTUARY AREA.

REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

FIRE PROTECTION NOTES

ORDINARY HAZARD GROUP 2
FIRE PROTECTION REQUIREMENTS

NOTE:
AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "ORDINARY HAZARD - GROUP 2" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR STORAGE AND MECHANICAL AREAS)

WET PIPE SYSTEM

1. ORDINARY HAZARD GROUP 2 PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 130 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A WET PIPE SYSTEM W/ ELECTRONIC CONTROLS.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS.
5. SPRINKLER HEADS IN FINISHED CEILING AREAS TO BE CONCEALED W/ WHITE FINISHED PLATE. HEADS UNFINISHED AREAS TO BE UPRIGHT BRASS (MATCH EXISTING).

NOTE: REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

DRAWINGS SHALL BE REVIEWED AND STAMPED BY A/E PRIOR TO START OF ANY NEW WORK. APPROVED PLANS SHALL BE SENT TO ARCHITECT.


DRAWING SET	CD
COPYRIGHT	2013
STRANG, INC.	
FILE NAME	2013027_02-FP201A.DWG
REVISIONS	
ADDENDUM # 3	11-18-13
DRAWN	DF
CHECKED	RG
DATE	10-29-13
PROJECT NO.	2013027_02
PROJECT TITLE	

ALLIANT ENERGY CENTER PAVILIONS
BID # 313072


1919 ALLIANT ENERGY CENTER WAY
MADISON, WISCONSIN 53713

SHEET TITLE
**FIRST FLOOR
FIRE PROTECTION
PLAN AREA A - BLD 1**

SHEET NO.
FP201A

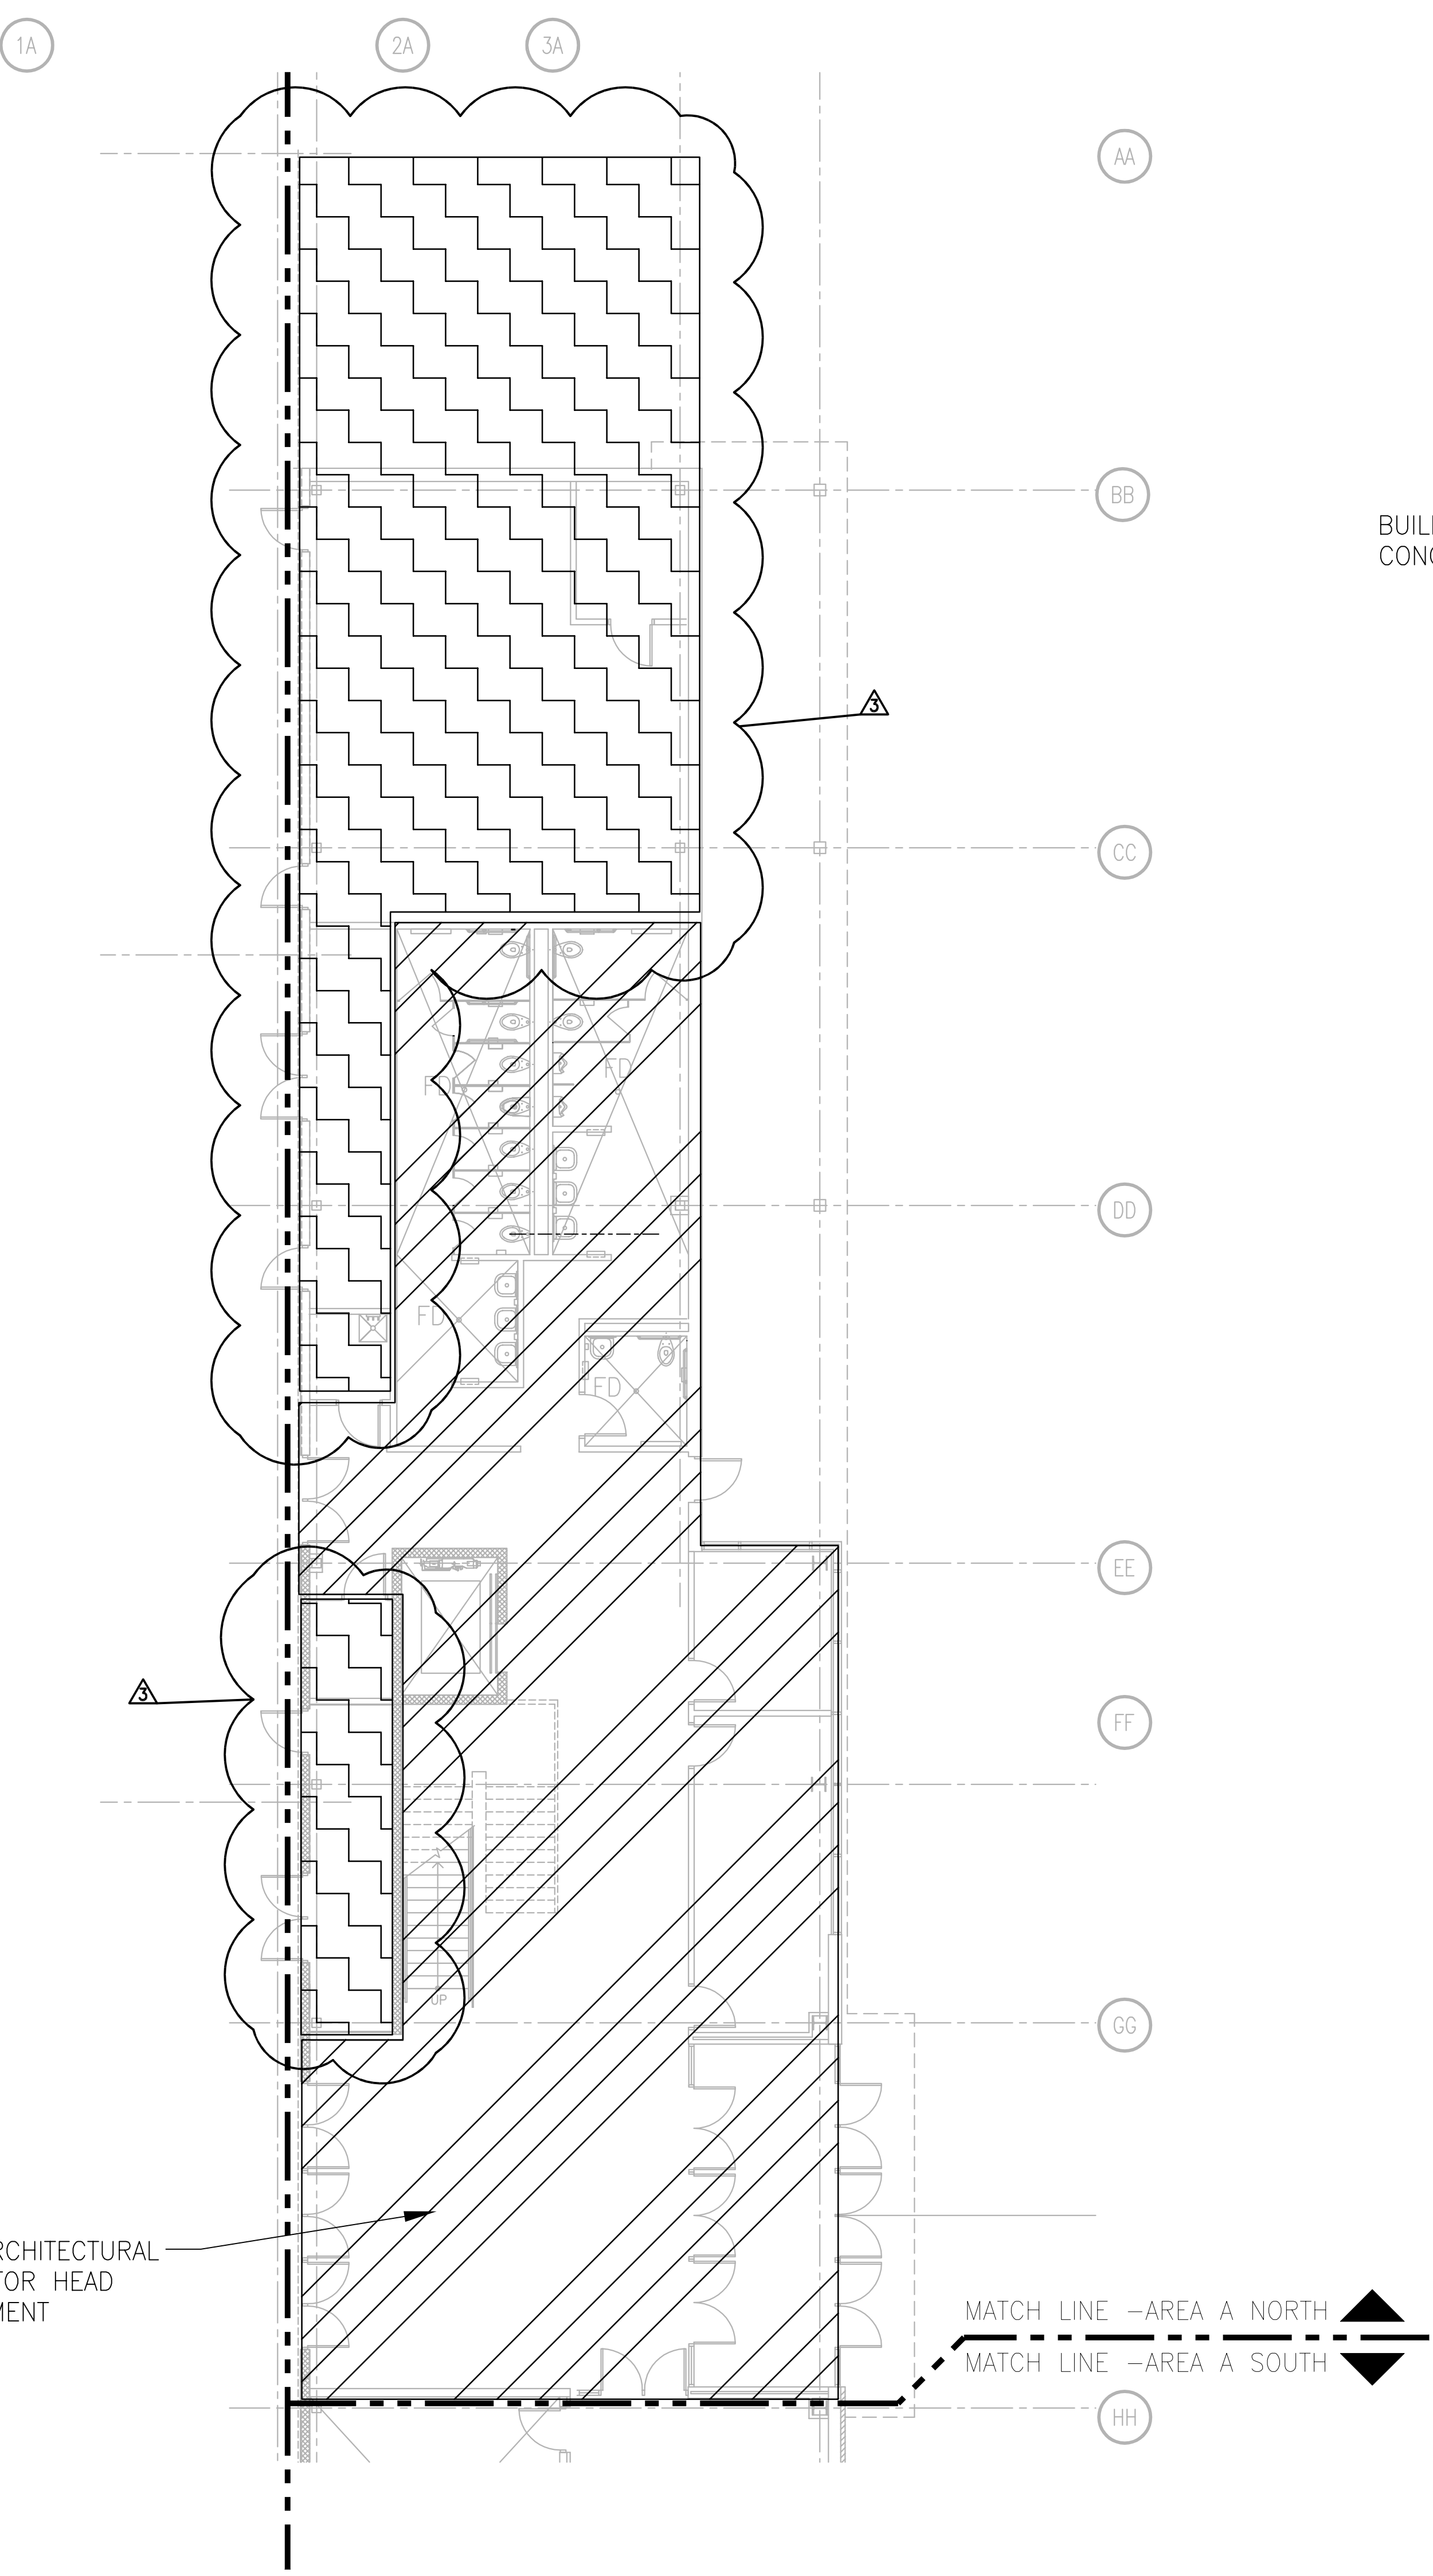

FIRST FLOOR FIRE PROTECTION PLAN - AREA A NORTH
SCALE: 1/8" = 1'-0"

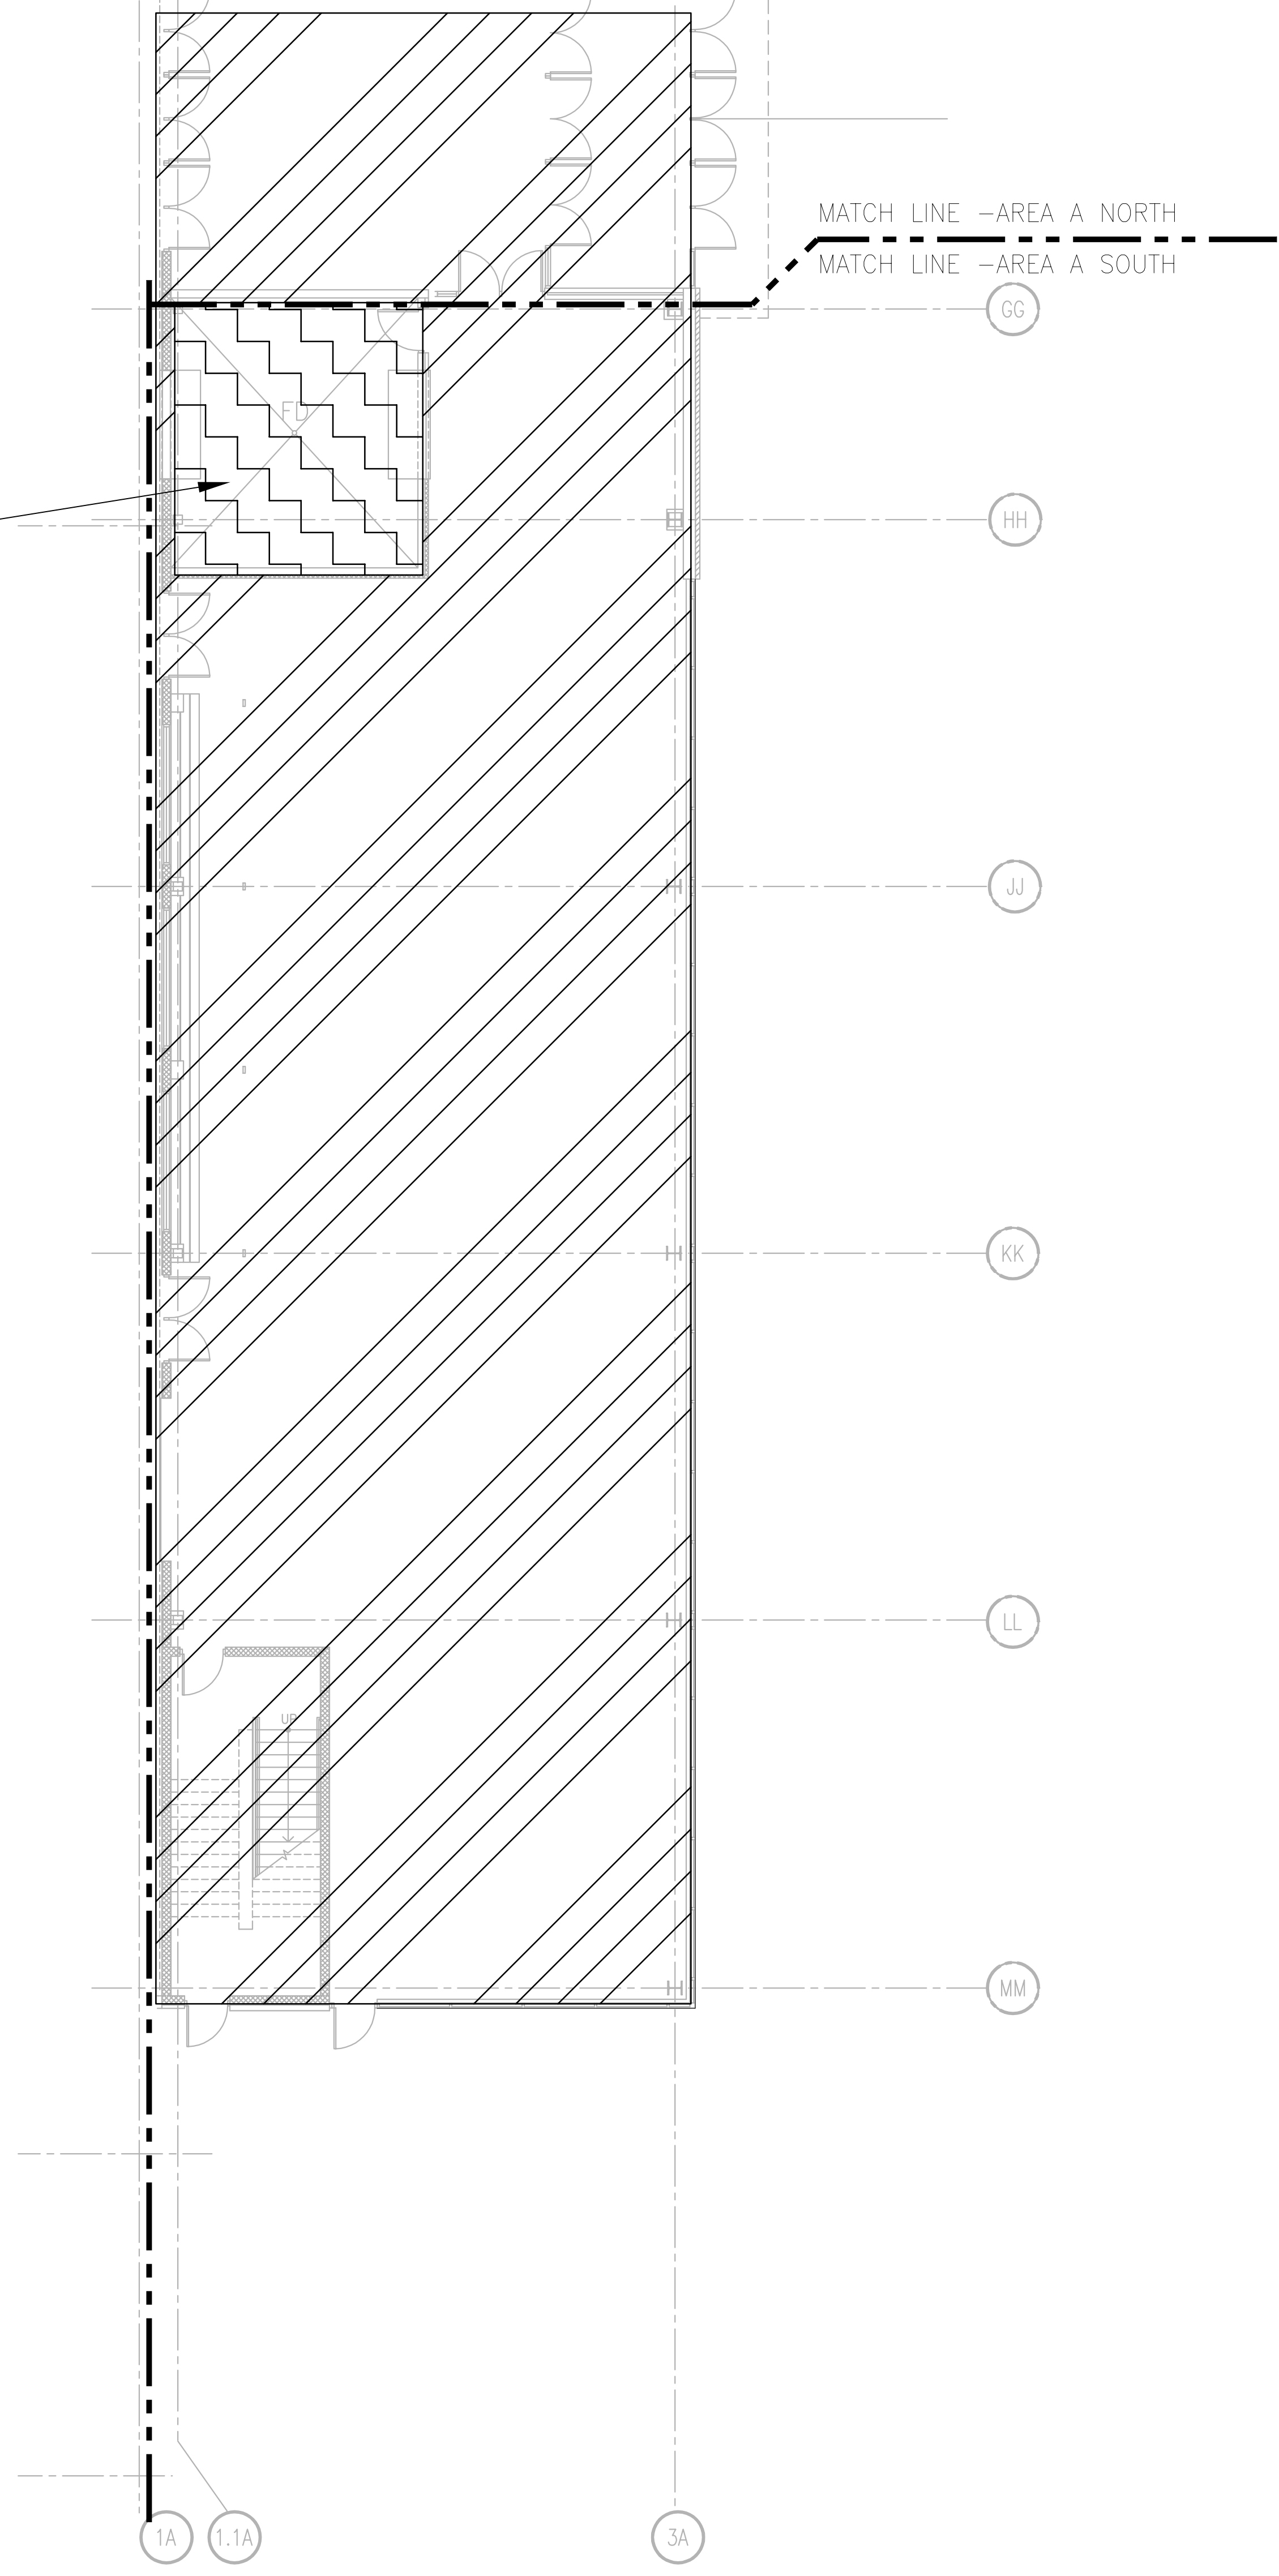


FIRST FLOOR FIRE PROTECTION PLAN - AREA A SOUTH
SCALE: 1/8" = 1'-0"



KEY PLAN

DALE FEINER 2009-9-30 2:27 PM N:\313072\02-FP201A.DWG - ALLIANT ENERGY CENTER LIFESTOCK & EXHIBITION HALL DRAWINGS\2013027_02-FP201A.DWG

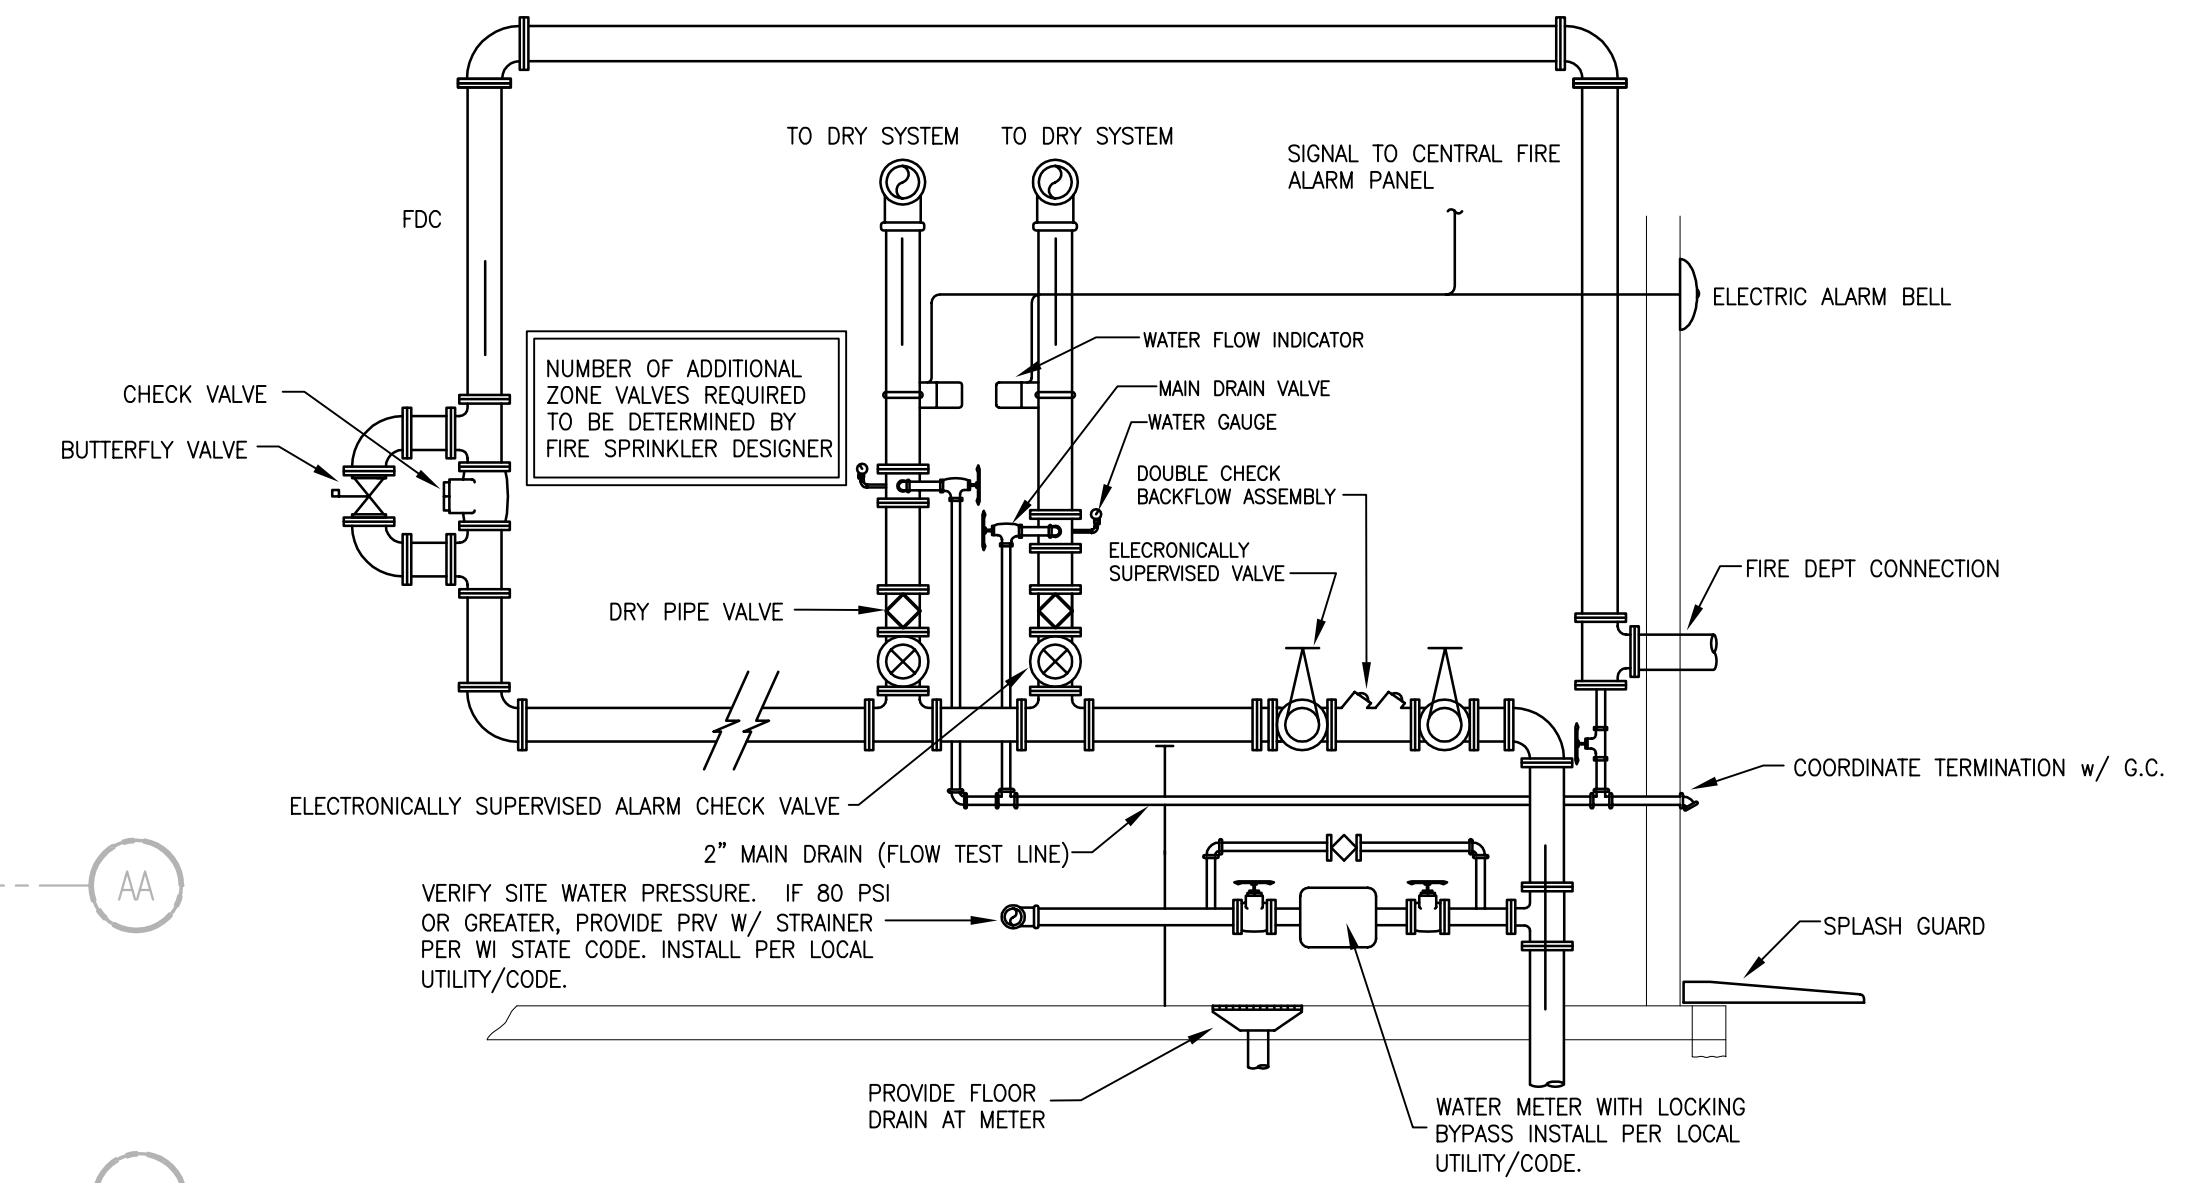

2 RISER DETAIL
FP201B SCALE: NONE

FIRE PROTECTION NOTES

LIGHT HAZARD
FIRE PROTECTION REQUIREMENTS

NOTE:
AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "LIGHT HAZARD" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR OFFICE AND MEETING ROOM AREAS)

WET PIPE SYSTEM

1. LIGHT HAZARD PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 225 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A WET PIPE SYSTEM.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS
5. SPRINKLERS IN OFFICE AND SUPPORT SPACES WITH A TEMPERATURE RATING OF 160°F, DENSITY OF 0.10 GPM/SQ.FT.
6. SPRINKLER HEADS TO BE CONCEALED WITH WHITE COVER PLATE IN FINISHED SPACES. UPRIGHT BRASS IN UNFINISHED SPACES, AND PAINTED IN TO MATCH CEILING IN SANCTUARY AREA.

NOTE: REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

FIRE PROTECTION NOTES

ORDINARY HAZARD GROUP 2
FIRE PROTECTION REQUIREMENTS

NOTE:
AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "ORDINARY HAZARD - GROUP 2" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR STORAGE AND MECHANICAL AREAS)

WET PIPE SYSTEM

1. ORDINARY HAZARD GROUP 2 PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 130 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A WET PIPE SYSTEM W/ ELECTRONIC CONTROLS.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS
5. SPRINKLER HEADS IN FINISHED CEILING AREAS TO BE CONCEALED W/ WHITE FINISHED PLATE. HEADS UNFINISHED AREAS TO BE UPRIGHT BRASS (MATCH EXISTING).

NOTE: REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

DRAWINGS SHALL BE REVIEWED AND STAMPED BY A/E PRIOR TO START OF ANY NEW WORK. APPROVED PLANS SHALL BE SENT TO ARCHITECT.


DRAWING SET	CD
COPYRIGHT	2013
STRANG, INC.	
FILE NAME	2013027_02-FP201B.DWG
REVISIONS	
ADDENDUM # 3	11-18-13
DRAWN	DF
CHECKED	RG
DATE	10-29-13
PROJECT NO.	2013027_02
PROJECT TITLE	

ALLIANT ENERGY CENTER PAVILIONS
BID # 313072

1919 ALLIANT ENERGY CENTER WAY
MADISON, WISCONSIN 53713

SHEET TITLE
FIRST FLOOR
FIRE PROTECTION
PLAN AREA B - BLD 1


SHEET NO.
FP201B

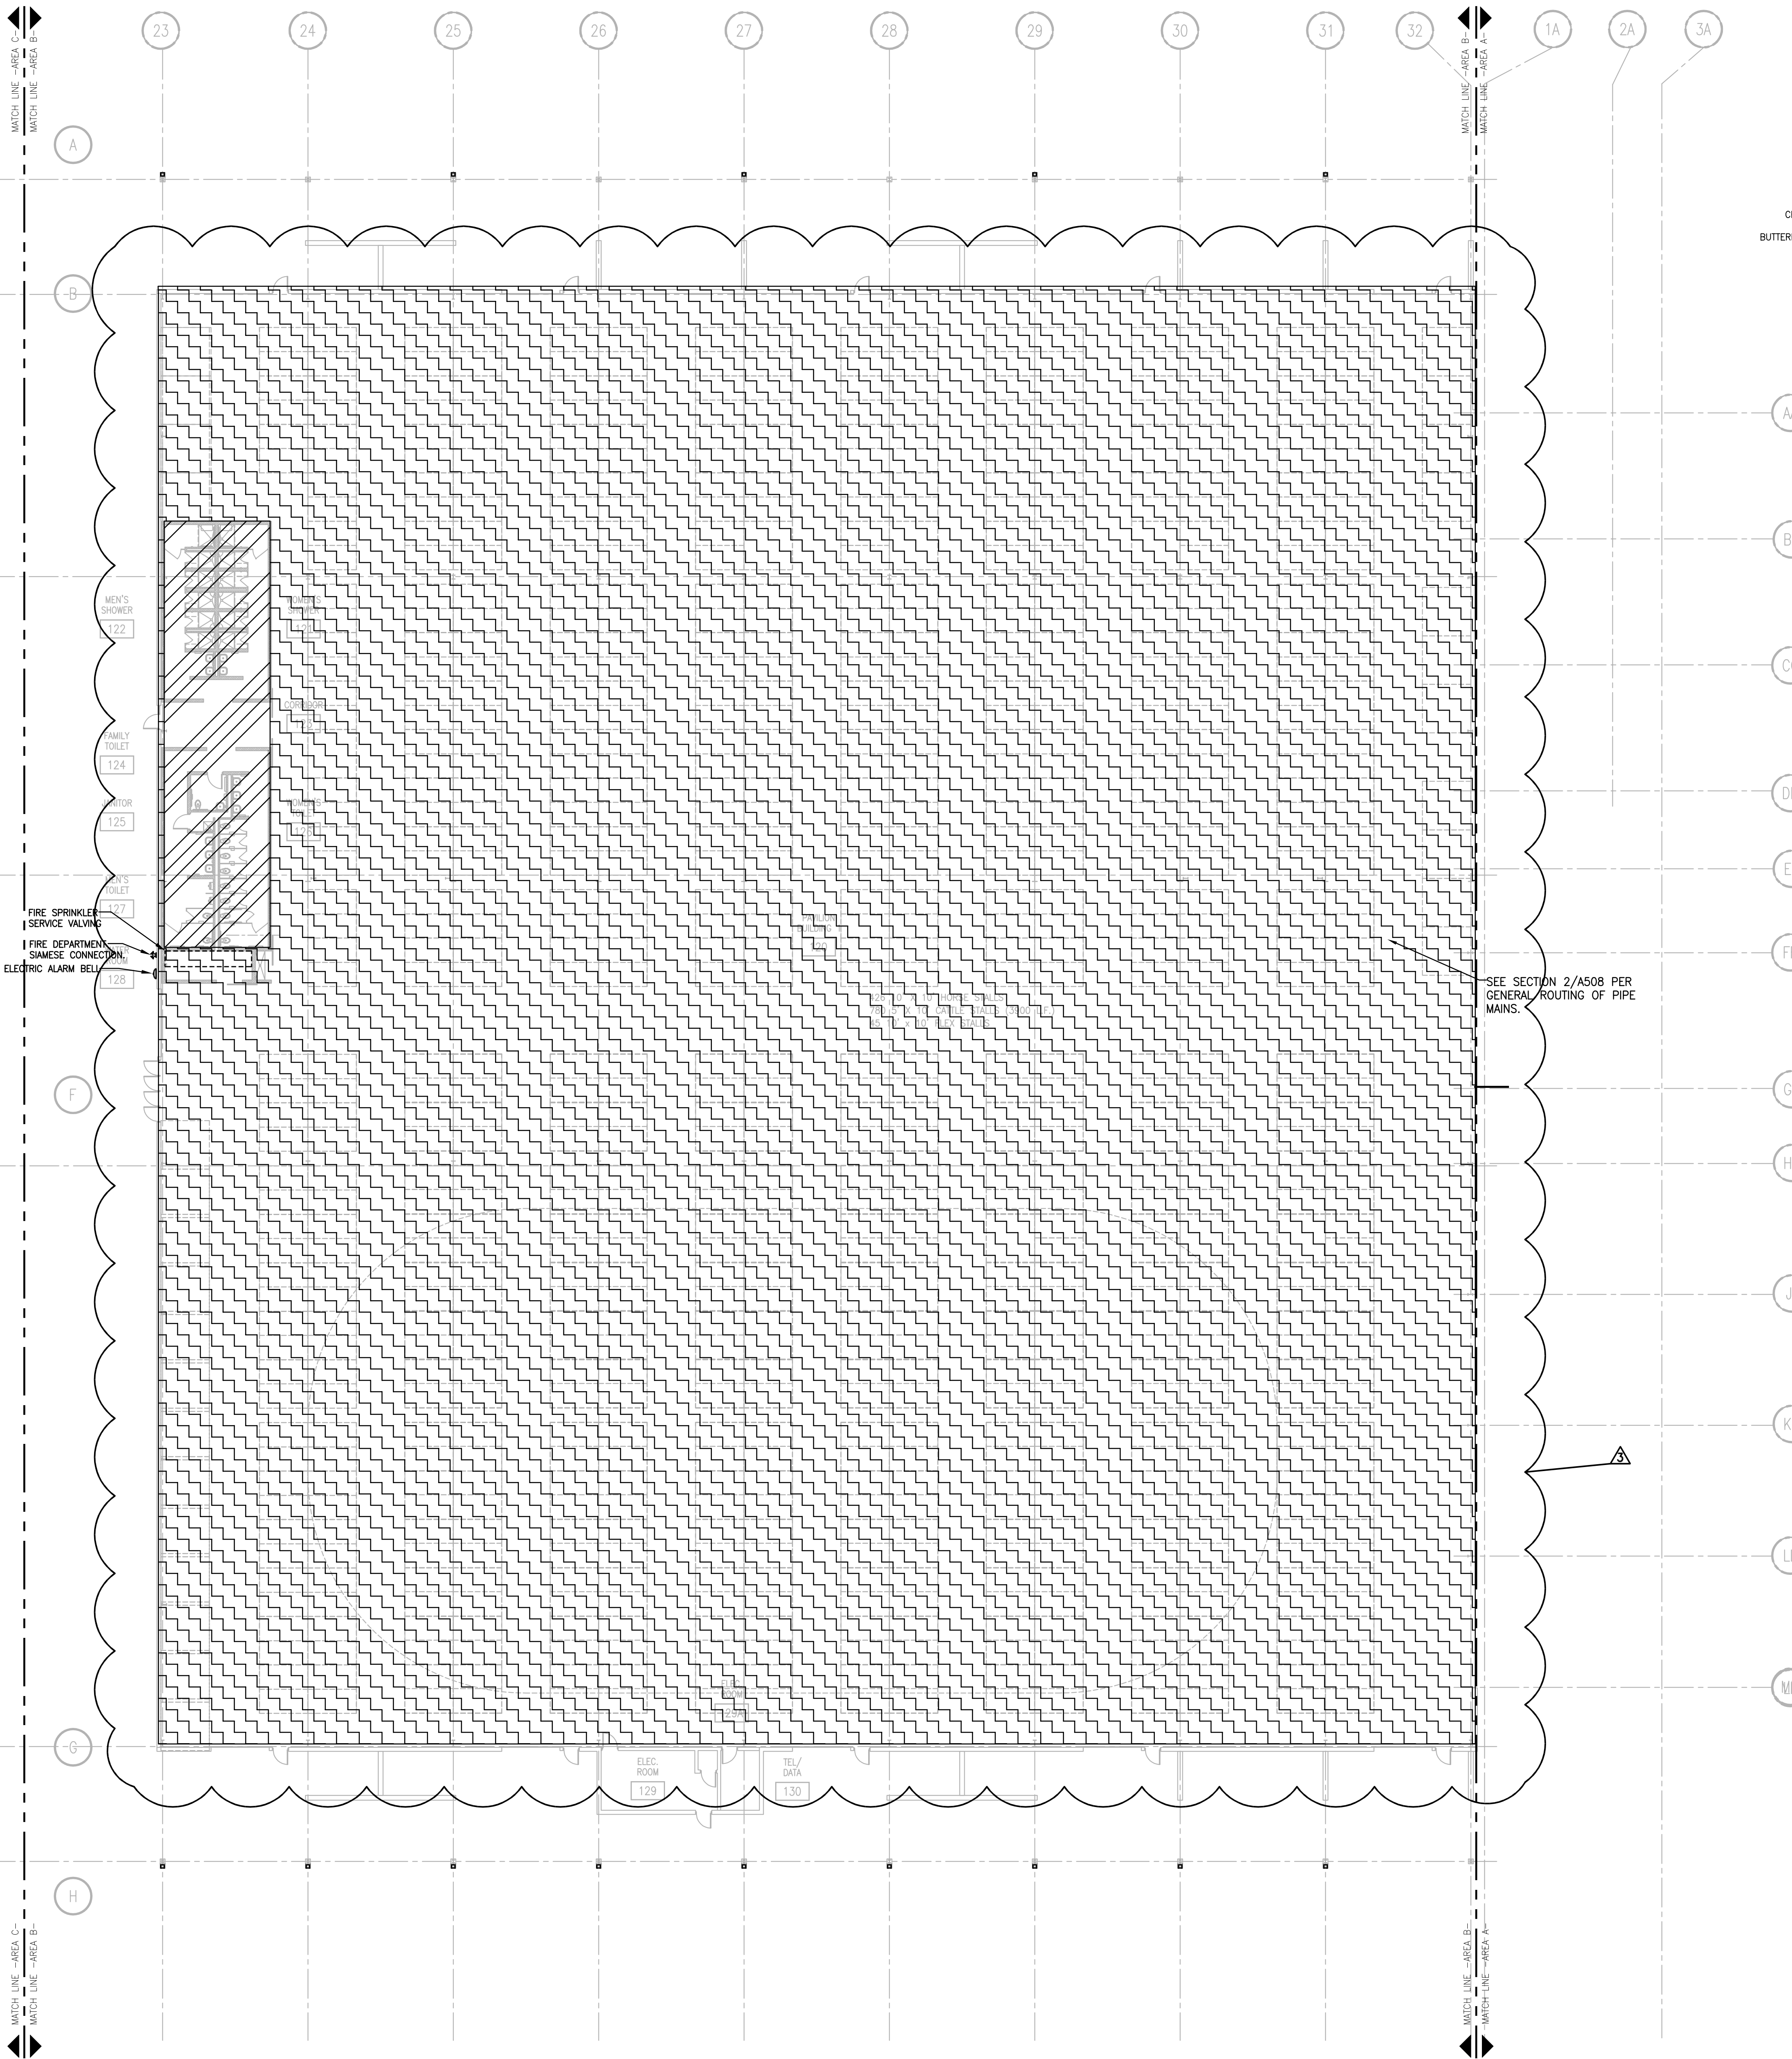


1 FIRST FLOOR FIRE PROTECTION PLAN - AREA B
SCALE: 1/16" = 1'-0"

DALE FEINER 2009-6-30 2:27 PM K:\013027007-ALLIANT ENERGY CENTER LIFESTOCK & EXHIBITION SPACE EXPANSION\013027_02-FP201B.DWG

DALE FEINER 2009-9-30 2:27 PM K:\2013027-ALLIANT ENERGY CENTER LIVES TOCK & EXHIBITION SPACE EXPANSION\013027_02-ALLIANT ENERGY CENTER - LIVES TOCK AND EXHIBITION HALL\DRAWINGS\2013027_02-FP201C.DWG

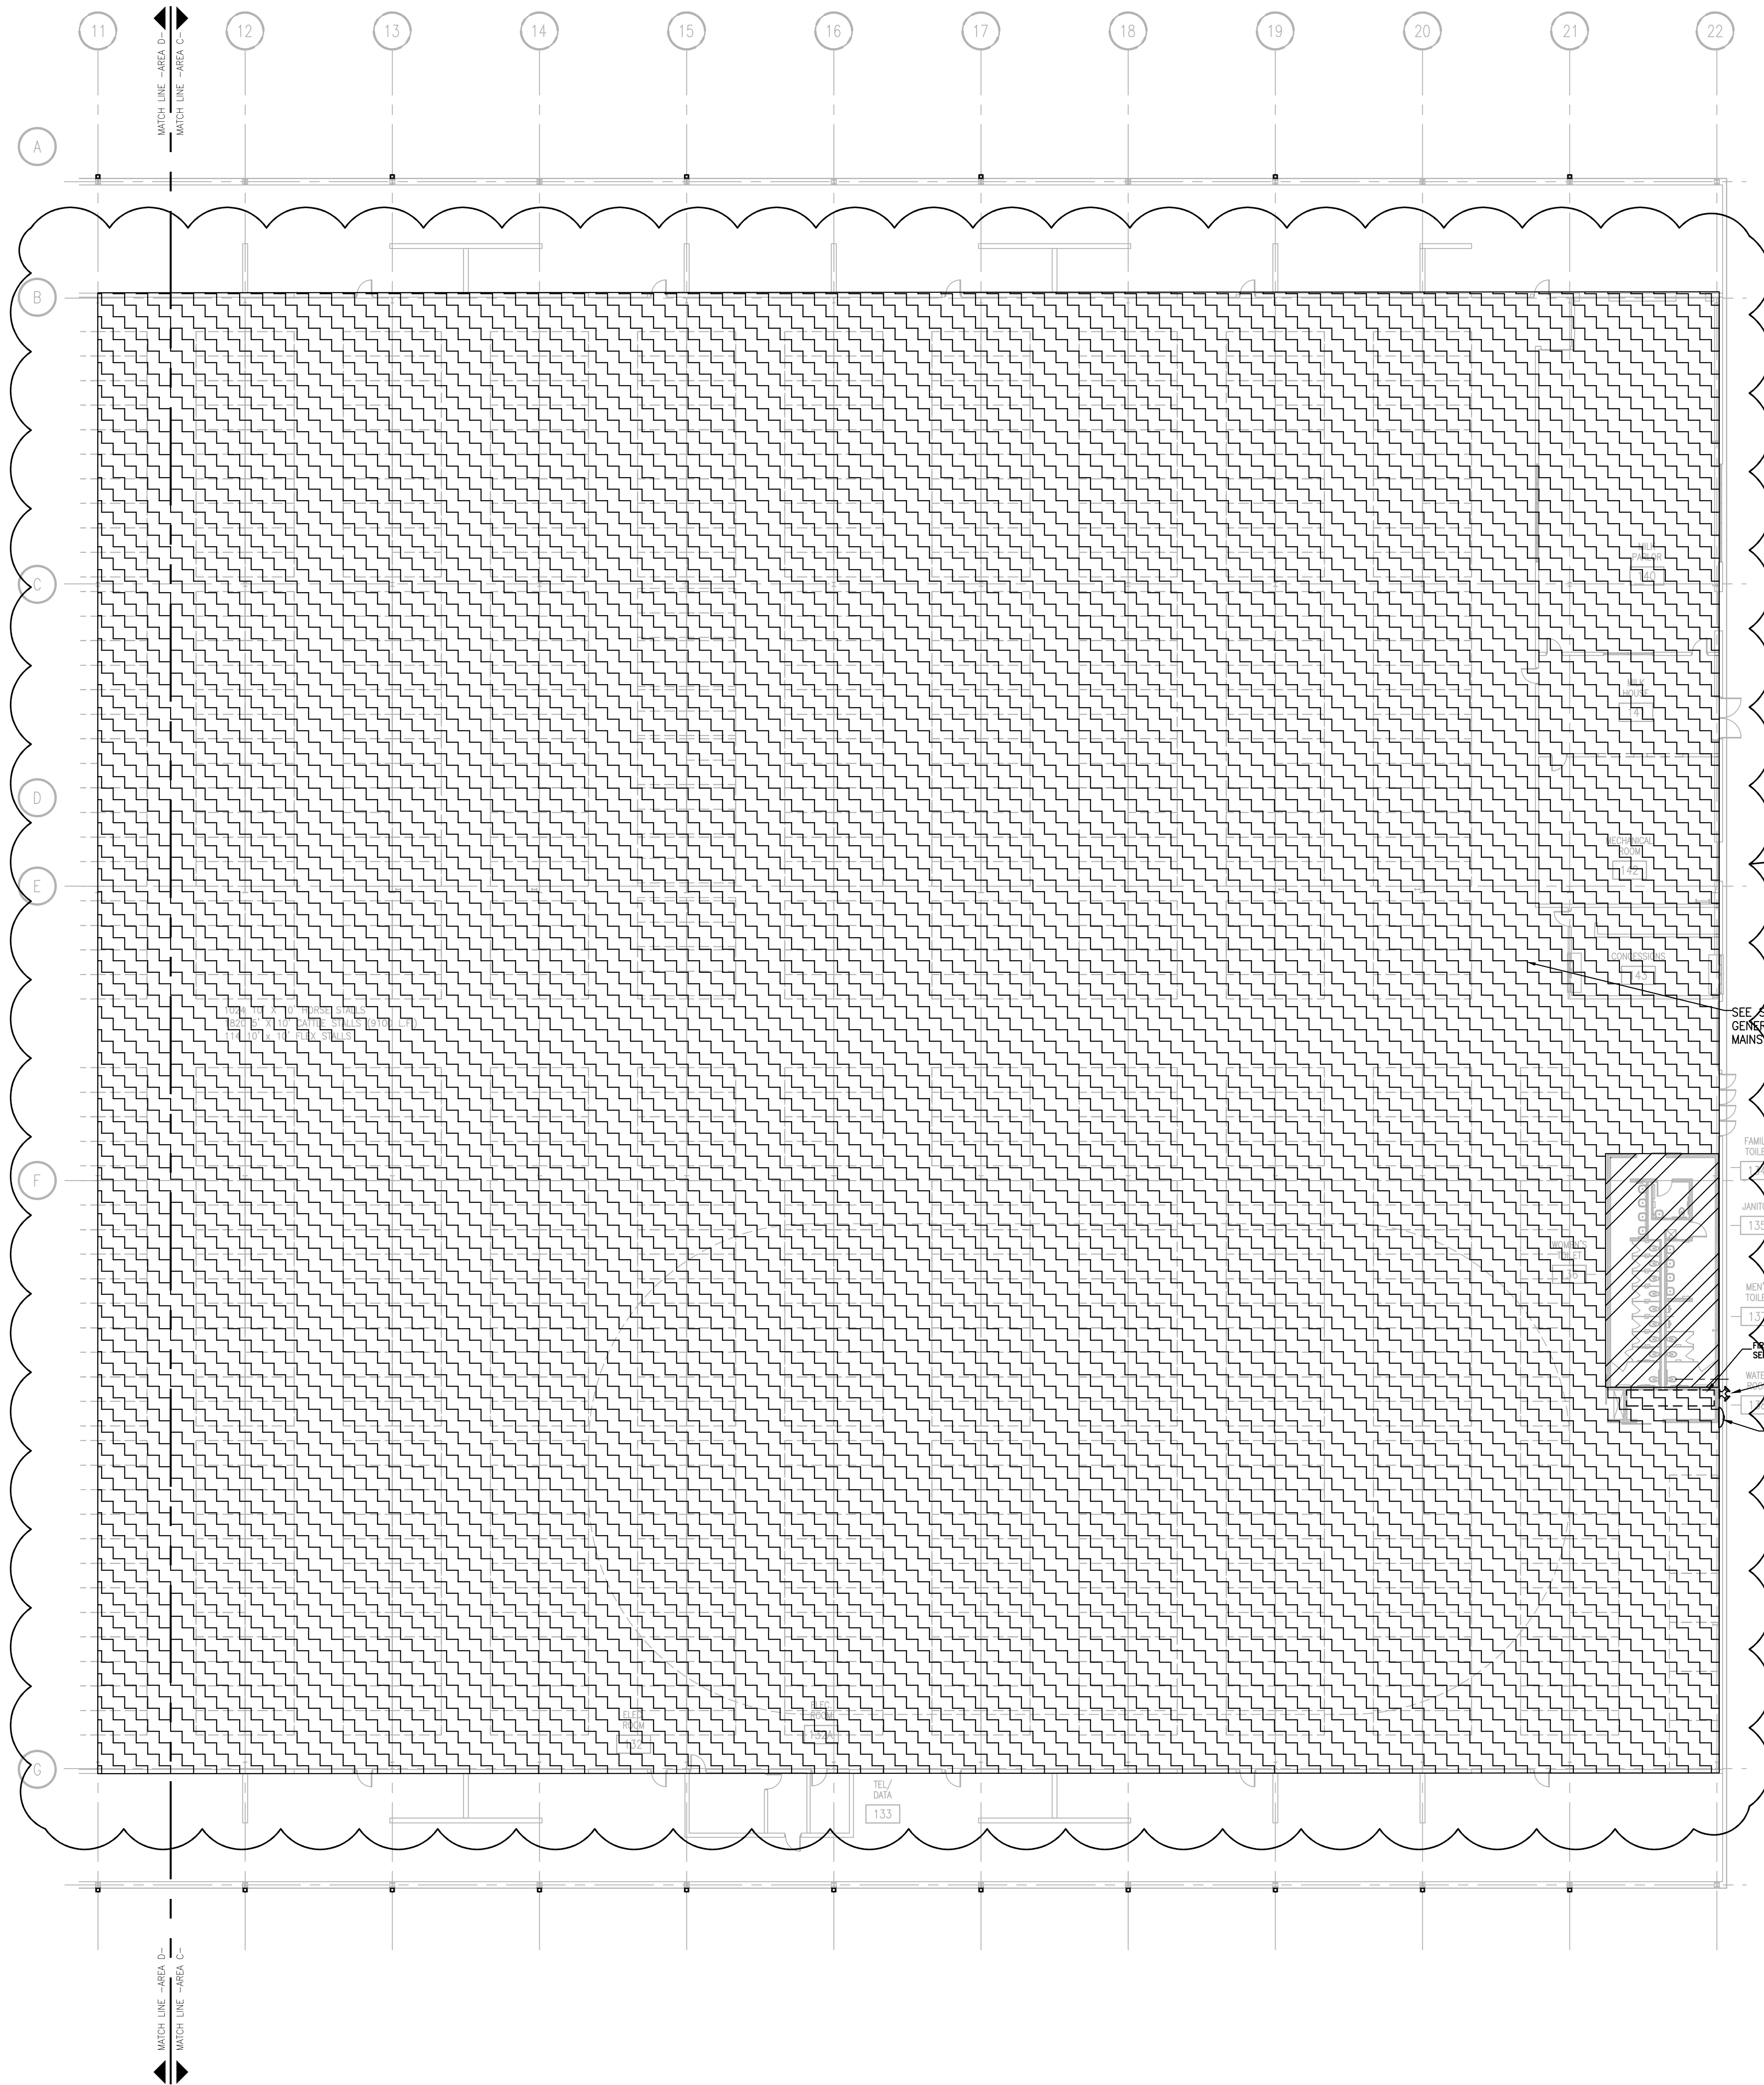

FIRST FLOOR FIRE PROTECTION PLAN - AREA C
 SCALE: 1/16" = 1'-0"

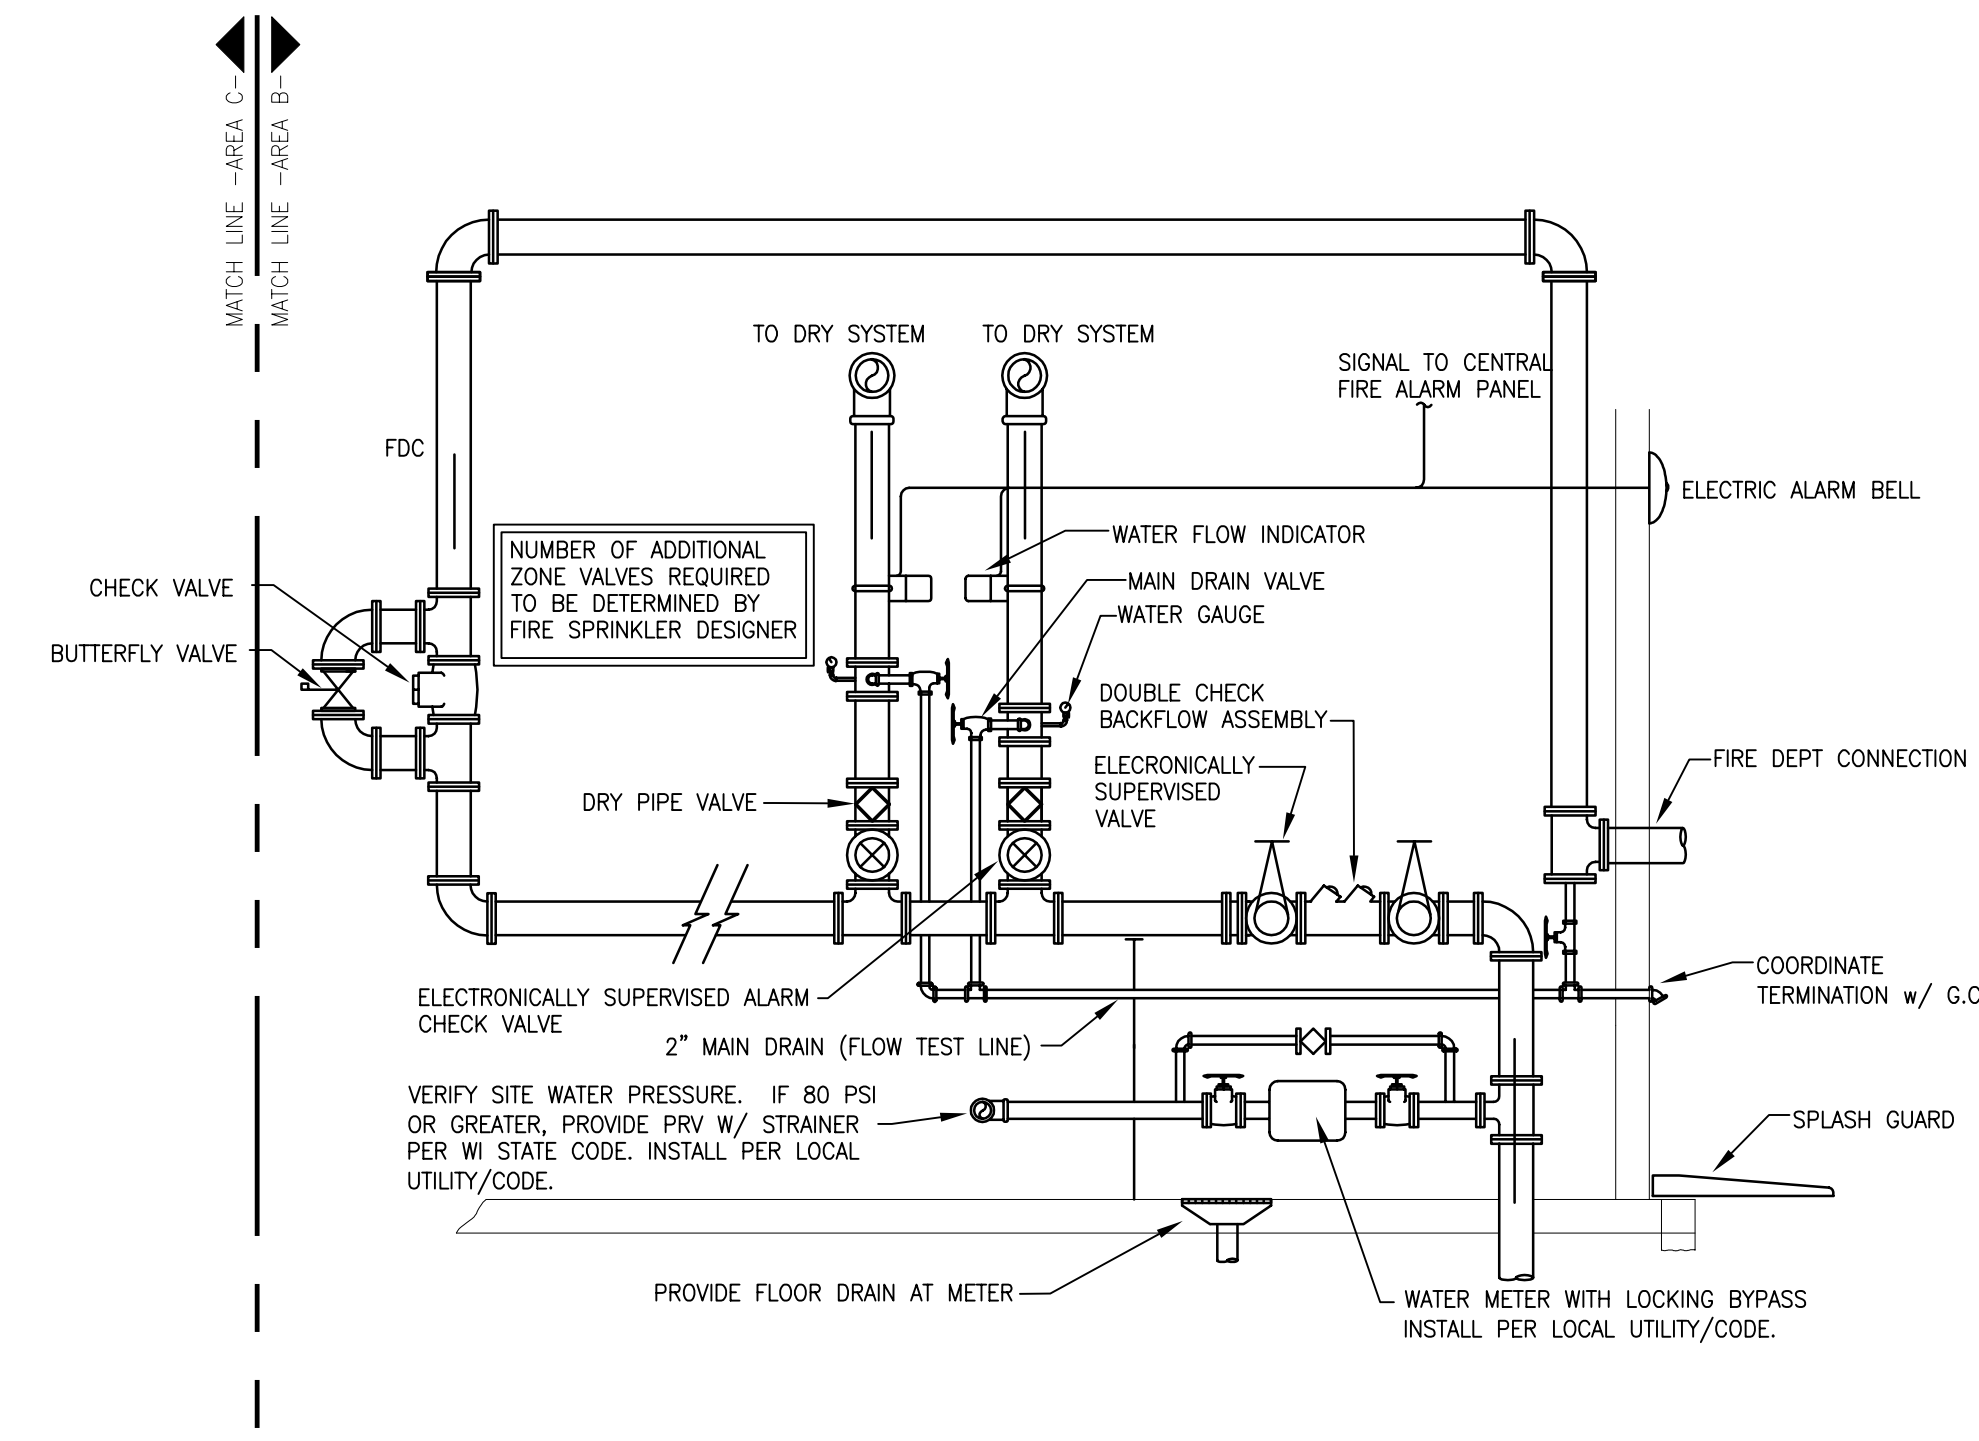

2 RISER DETAIL
 SCALE: NONE

FIRE PROTECTION NOTES

NOTE:
 AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "LIGHT HAZARD" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR OFFICE AND MEETING ROOM AREAS)

DRY PIPE SYSTEM

1. LIGHT HAZARD PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 225 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A DRY PIPE SYSTEM W/ ELECTRONIC CONTROLS.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS
5. SPRINKLERS IN OFFICE AND SUPPORT SPACES WITH A TEMPERATURE RATING OF 165°F; DENSITY OF 0.10 GPM/SQ.FT.
6. SPRINKLER HEADS TO BE CONCEALED WITH WHITE COVER PLATE IN FINISHED SPACES, UPRIGHT BRASS IN UNFINISHED SPACES, AND PAINTED IN TO MATCH CEILING IN SANCTUARY AREA.

NOTE: REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

FIRE PROTECTION NOTES

NOTE:
 AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "ORDINARY HAZARD - GROUP 2" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR STORAGE AND MECHANICAL AREAS)

DRY PIPE SYSTEM

1. ORDINARY HAZARD GROUP 2 PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 130 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A DRY PIPE SYSTEM W/ ELECTRONIC CONTROLS.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS
5. SPRINKLER HEADS IN FINISHED CEILING AREAS TO BE CONCEALED W/ WHITE FINISHED PLATE. HEADS UNFINISHED AREAS TO BE UPRIGHT BRASS.

NOTE: REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

DRAWINGS SHALL BE REVIEWED AND STAMPED BY A/E PRIOR TO START OF ANY NEW WORK. APPROVED PLANS SHALL BE SENT TO ARCHITECT.

STRANG


ARCHITECTURE
 ENGINEERING
 INTERIOR DESIGN

STRANG INC.
 6415 MINERAL POINT ROAD
 MADISON, WI 53705-4395
 T/ 608 278 9200
 F/ 608 278 9204

DRAWING SET	CD
COPYRIGHT	2013
STRANG, INC.	
FILE NAME	2013027_02-FP201C.DWG
REVISIONS	ADDENDUM # 3 11-18-13
DRAWN	DF
CHECKED	RG
DATE	10-29-13
PROJECT NO.	2013027_02
PROJECT TITLE	

**ALLIANT ENERGY CENTER PAVILIONS
 BID # 313072**


1919 ALLIANT ENERGY CENTER WAY
 MADISON, WISCONSIN 53713

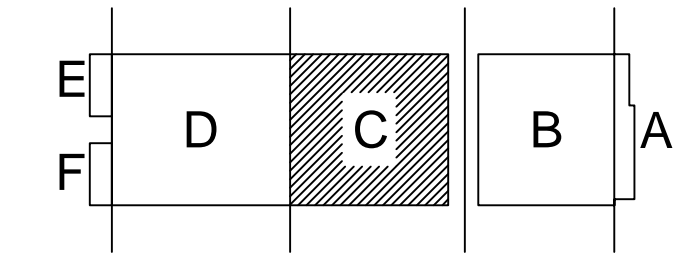

KEY PLAN

SHEET TITLE
**FIRST FLOOR
 FIRE PROTECTION
 PLAN AREA C - BLD 2**

SHEET NO.
FP201C

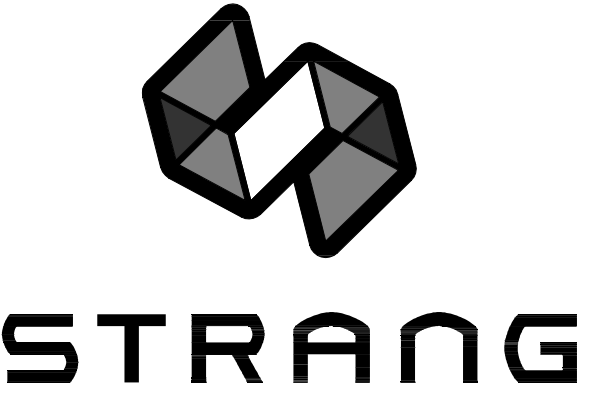


ARCHITECTURE
ENGINEERING
INTERIOR DESIGN

STRANG INC.
6415 MINERAL POINT ROAD
MADISON, WI 53705-4395
T/ 608 276 9200
F/ 608 276 9204

FIRE PROTECTION NOTES

ORDINARY HAZARD GROUP 2
FIRE PROTECTION REQUIREMENTS



NOTE:
AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "ORDINARY HAZARD - GROUP 2" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR STORAGE AND MECHANICAL AREAS)


DRY PIPE SYSTEM

1. ORDINARY HAZARD GROUP 2 PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 130 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A DRY PIPE SYSTEM W/ ELECTRONIC CONTROLS.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS.
5. SPRINKLER HEADS IN FINISHED CEILING AREAS TO BE CONCEALED W/ WHITE FINISHED PLATE. HEADS UNFINISHED AREAS TO BE UPRIGHT BRASS.

NOTE: REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

FIRE PROTECTION NOTES

LIGHT HAZARD
FIRE PROTECTION REQUIREMENTS




NOTE:
AREAS SHOWN WITH DIAGONAL HATCHING (AS ABOVE) SHALL HAVE FIRE PROTECTION SYSTEM DESIGNED AND INSTALLED TO MEET NFPA "LIGHT HAZARD" OCCUPANCY CLASSIFICATION REQUIREMENTS (TYP. FOR OFFICE AND MEETING ROOM AREAS)

DRY PIPE SYSTEM

1. LIGHT HAZARD PROJECTED AREA PER SPRINKLER HEAD SHALL NOT EXCEED 225 SQ.FT.
2. SPRINKLER COVERAGE AND SYSTEM PIPING SHALL BE HYDRAULICALLY DESIGNED BY FIRE PROTECTION CONTRACTOR BASED ON NFPA REQUIREMENTS.
3. THE SYSTEM SHALL BE A DRY PIPE SYSTEM W/ ELECTRONIC CONTROLS.
4. SPACING SHALL NOT EXCEED 15 FT. BETWEEN SPRINKLER HEADS.
5. SPRINKLERS IN OFFICE AND SUPPORT SPACES WITH A TEMPERATURE RATING OF 165°F, DENSITY OF 0.10 GPM/SQ.FT.
6. SPRINKLER HEADS TO BE CONCEALED WITH WHITE COVER PLATE IN FINISHED SPACES, UPRIGHT BRASS IN UNFINISHED SPACES, AND PAINTED IN TO MATCH CEILING IN SANCTUARY AREA.

NOTE: REFER TO SPECIAL CEILING CONDITIONS ON ARCHITECTURAL DRAWINGS - COORDINATE LOCATIONS OF FIRE PROTECTION SPRINKLER HEADS WITH A/E PRIOR TO INSTALLATION.

DRAWINGS SHALL BE REVIEWED AND STAMPED BY ANI PRIOR TO START OF ANY NEW WORK APPROVED PLANS SHALL BE SENT TO ARCHITECT.

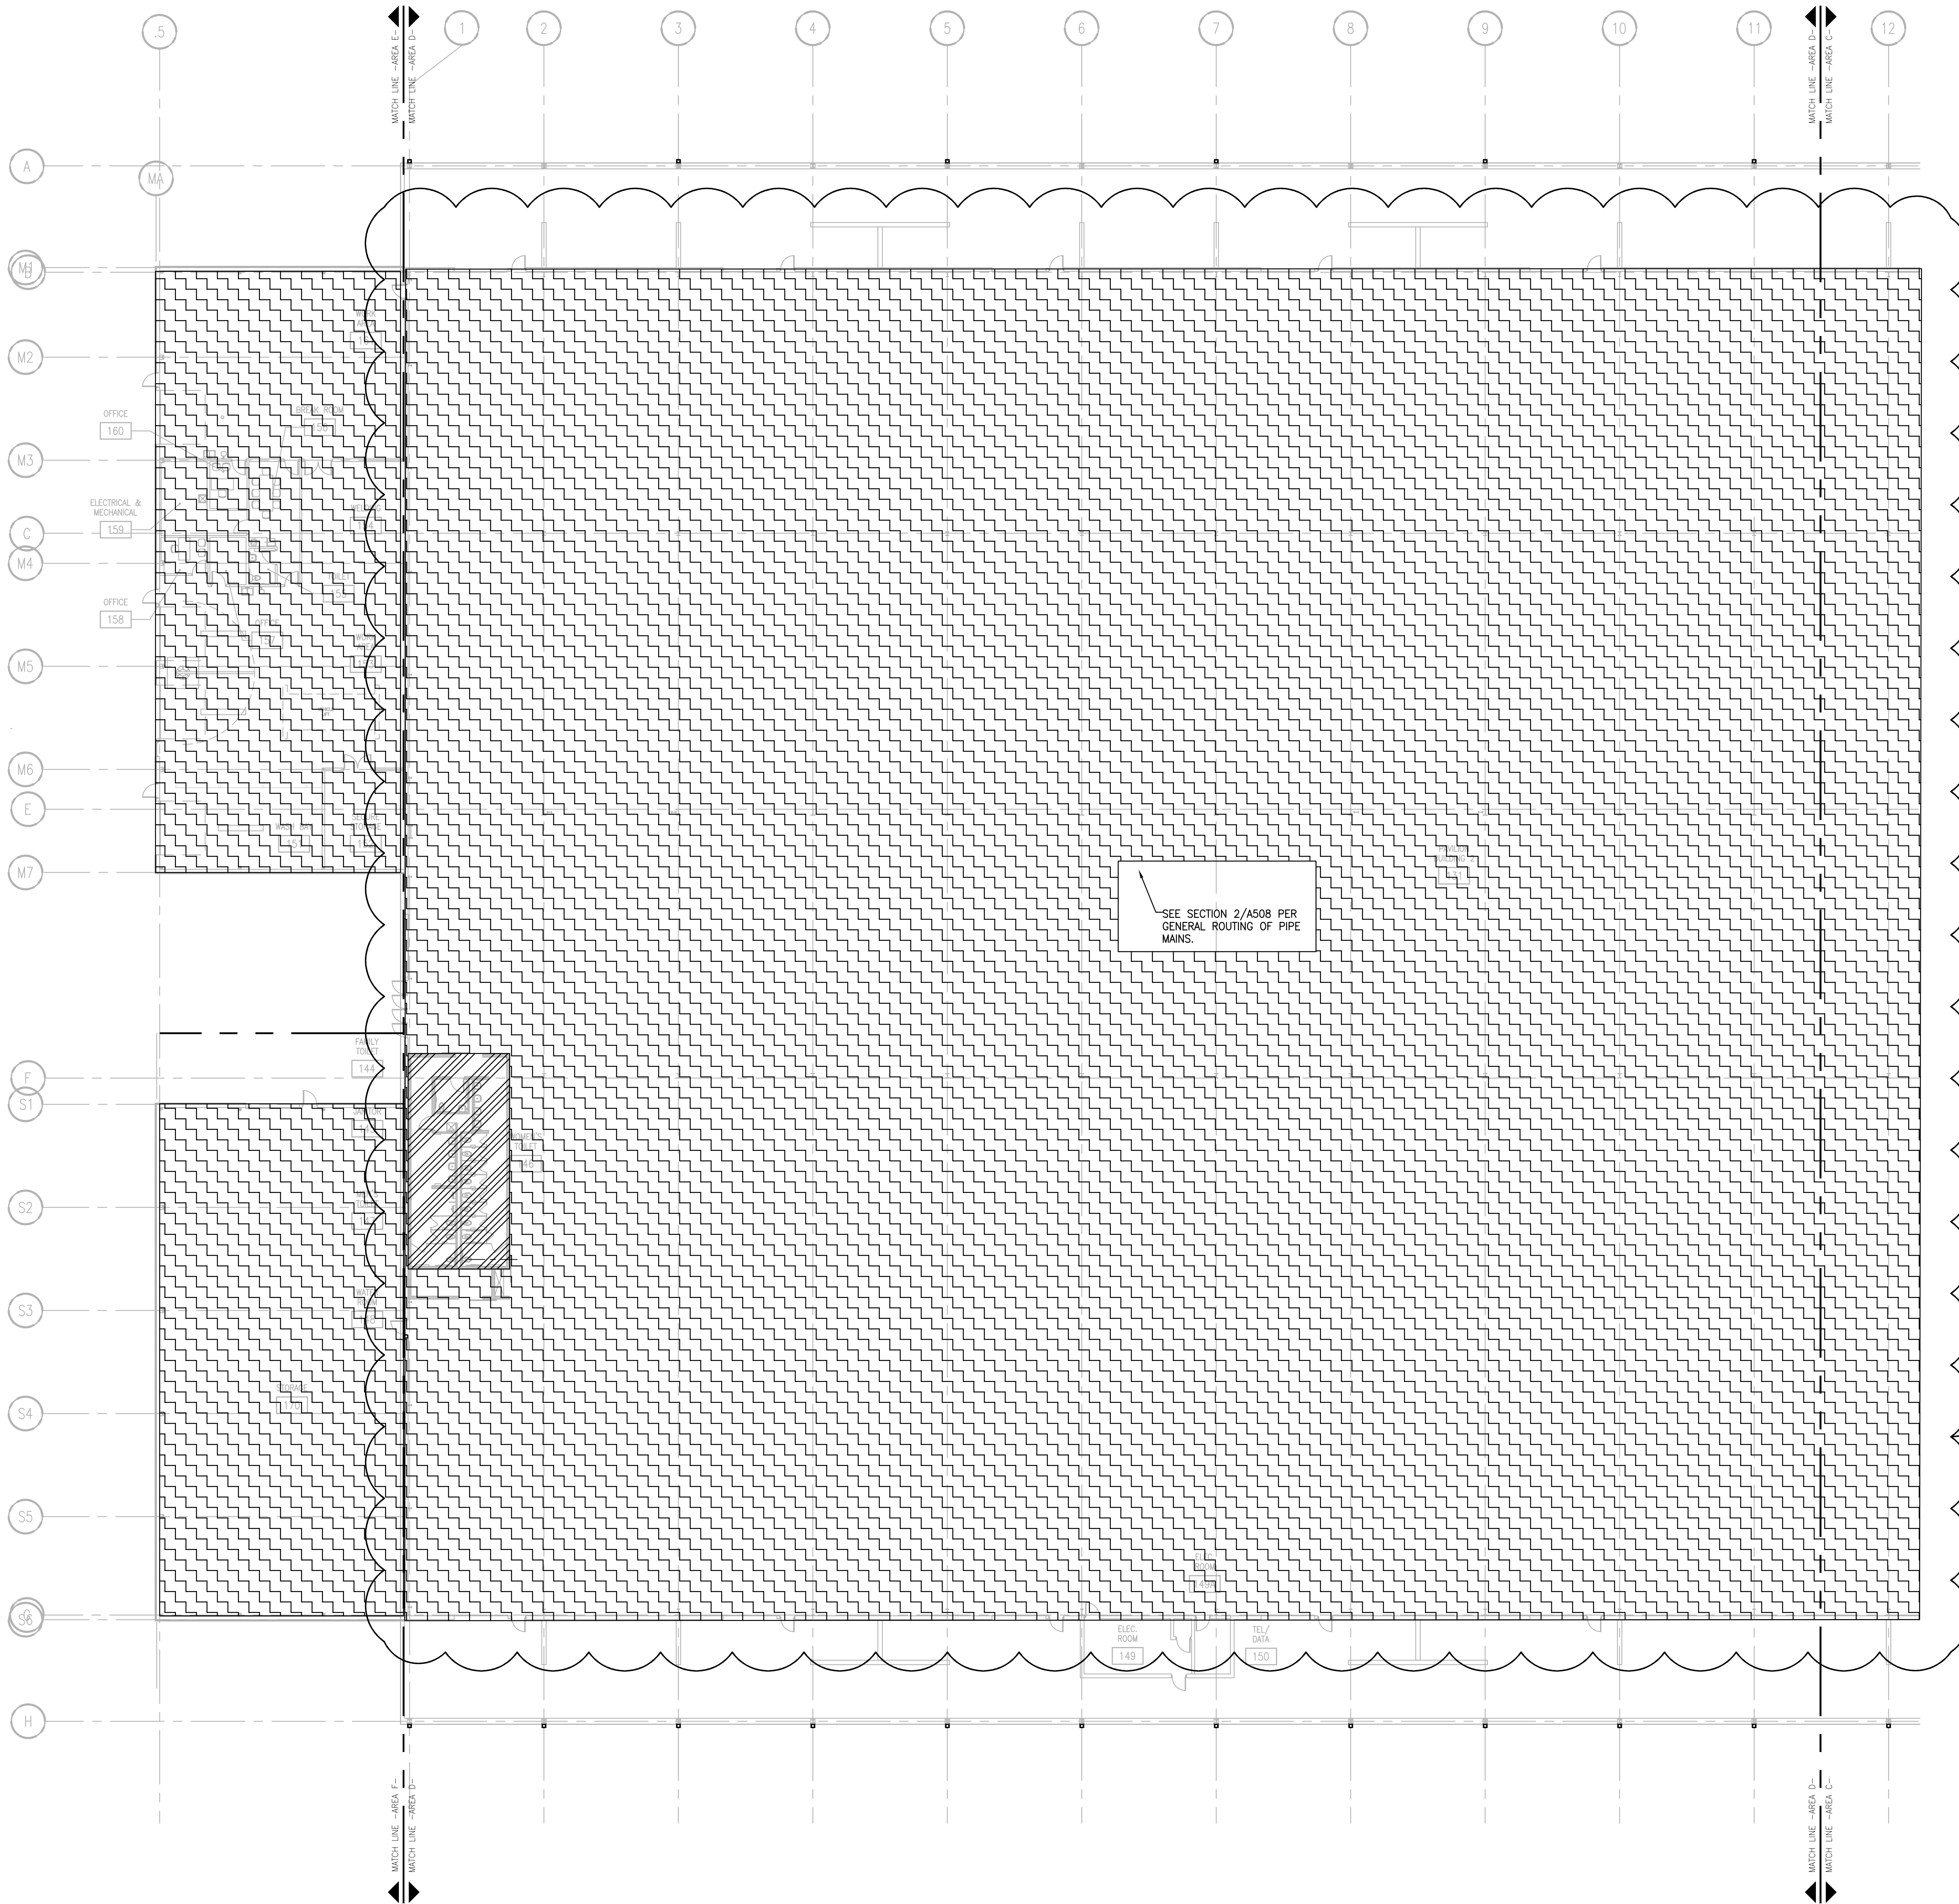

SEE SECTION 2/A508 PER GENERAL ROUTING OF PIPE MANS.

DALE FEINER 2009-9-30 2:27 PM K:\3102013027 - ALLIANT ENERGY CENTER LIVESTOCK & EXHIBITION SPACE EXPANSION\013027_02 - ALLIANT ENERGY CENTER - LIVESTOCK AND EXHIBITION HALLORAWINGS\2013027_02.FP201D.DWG

FIRST FLOOR FIRE PROTECTION PLAN - AREA D, E, & F
SCALE: 1/16" = 1'-0"

DRAWING SET	CD
COPYRIGHT	2013
FILE NAME	2013027_02-FP201D.DWG
REVISIONS	ADDENDUM # 3 11-18-13
DRAWN	DF
CHECKED	RG
DATE	10-29-13
PROJECT NO.	2013027_02
PROJECT TITLE	

ALLIANT ENERGY CENTER PAVILIONS
BID # 313072

1919 ALLIANT ENERGY CENTER WAY
MADISON, WISCONSIN 53713

SHEET TITLE
FIRST FLOOR FIRE PROTECTION PLAN
AREA D,E,F- BLD 2

SHEET NO.
FP201D

