


Dane County  
Alliant Energy Center  
Willow Island Electrification  
10/30/2103

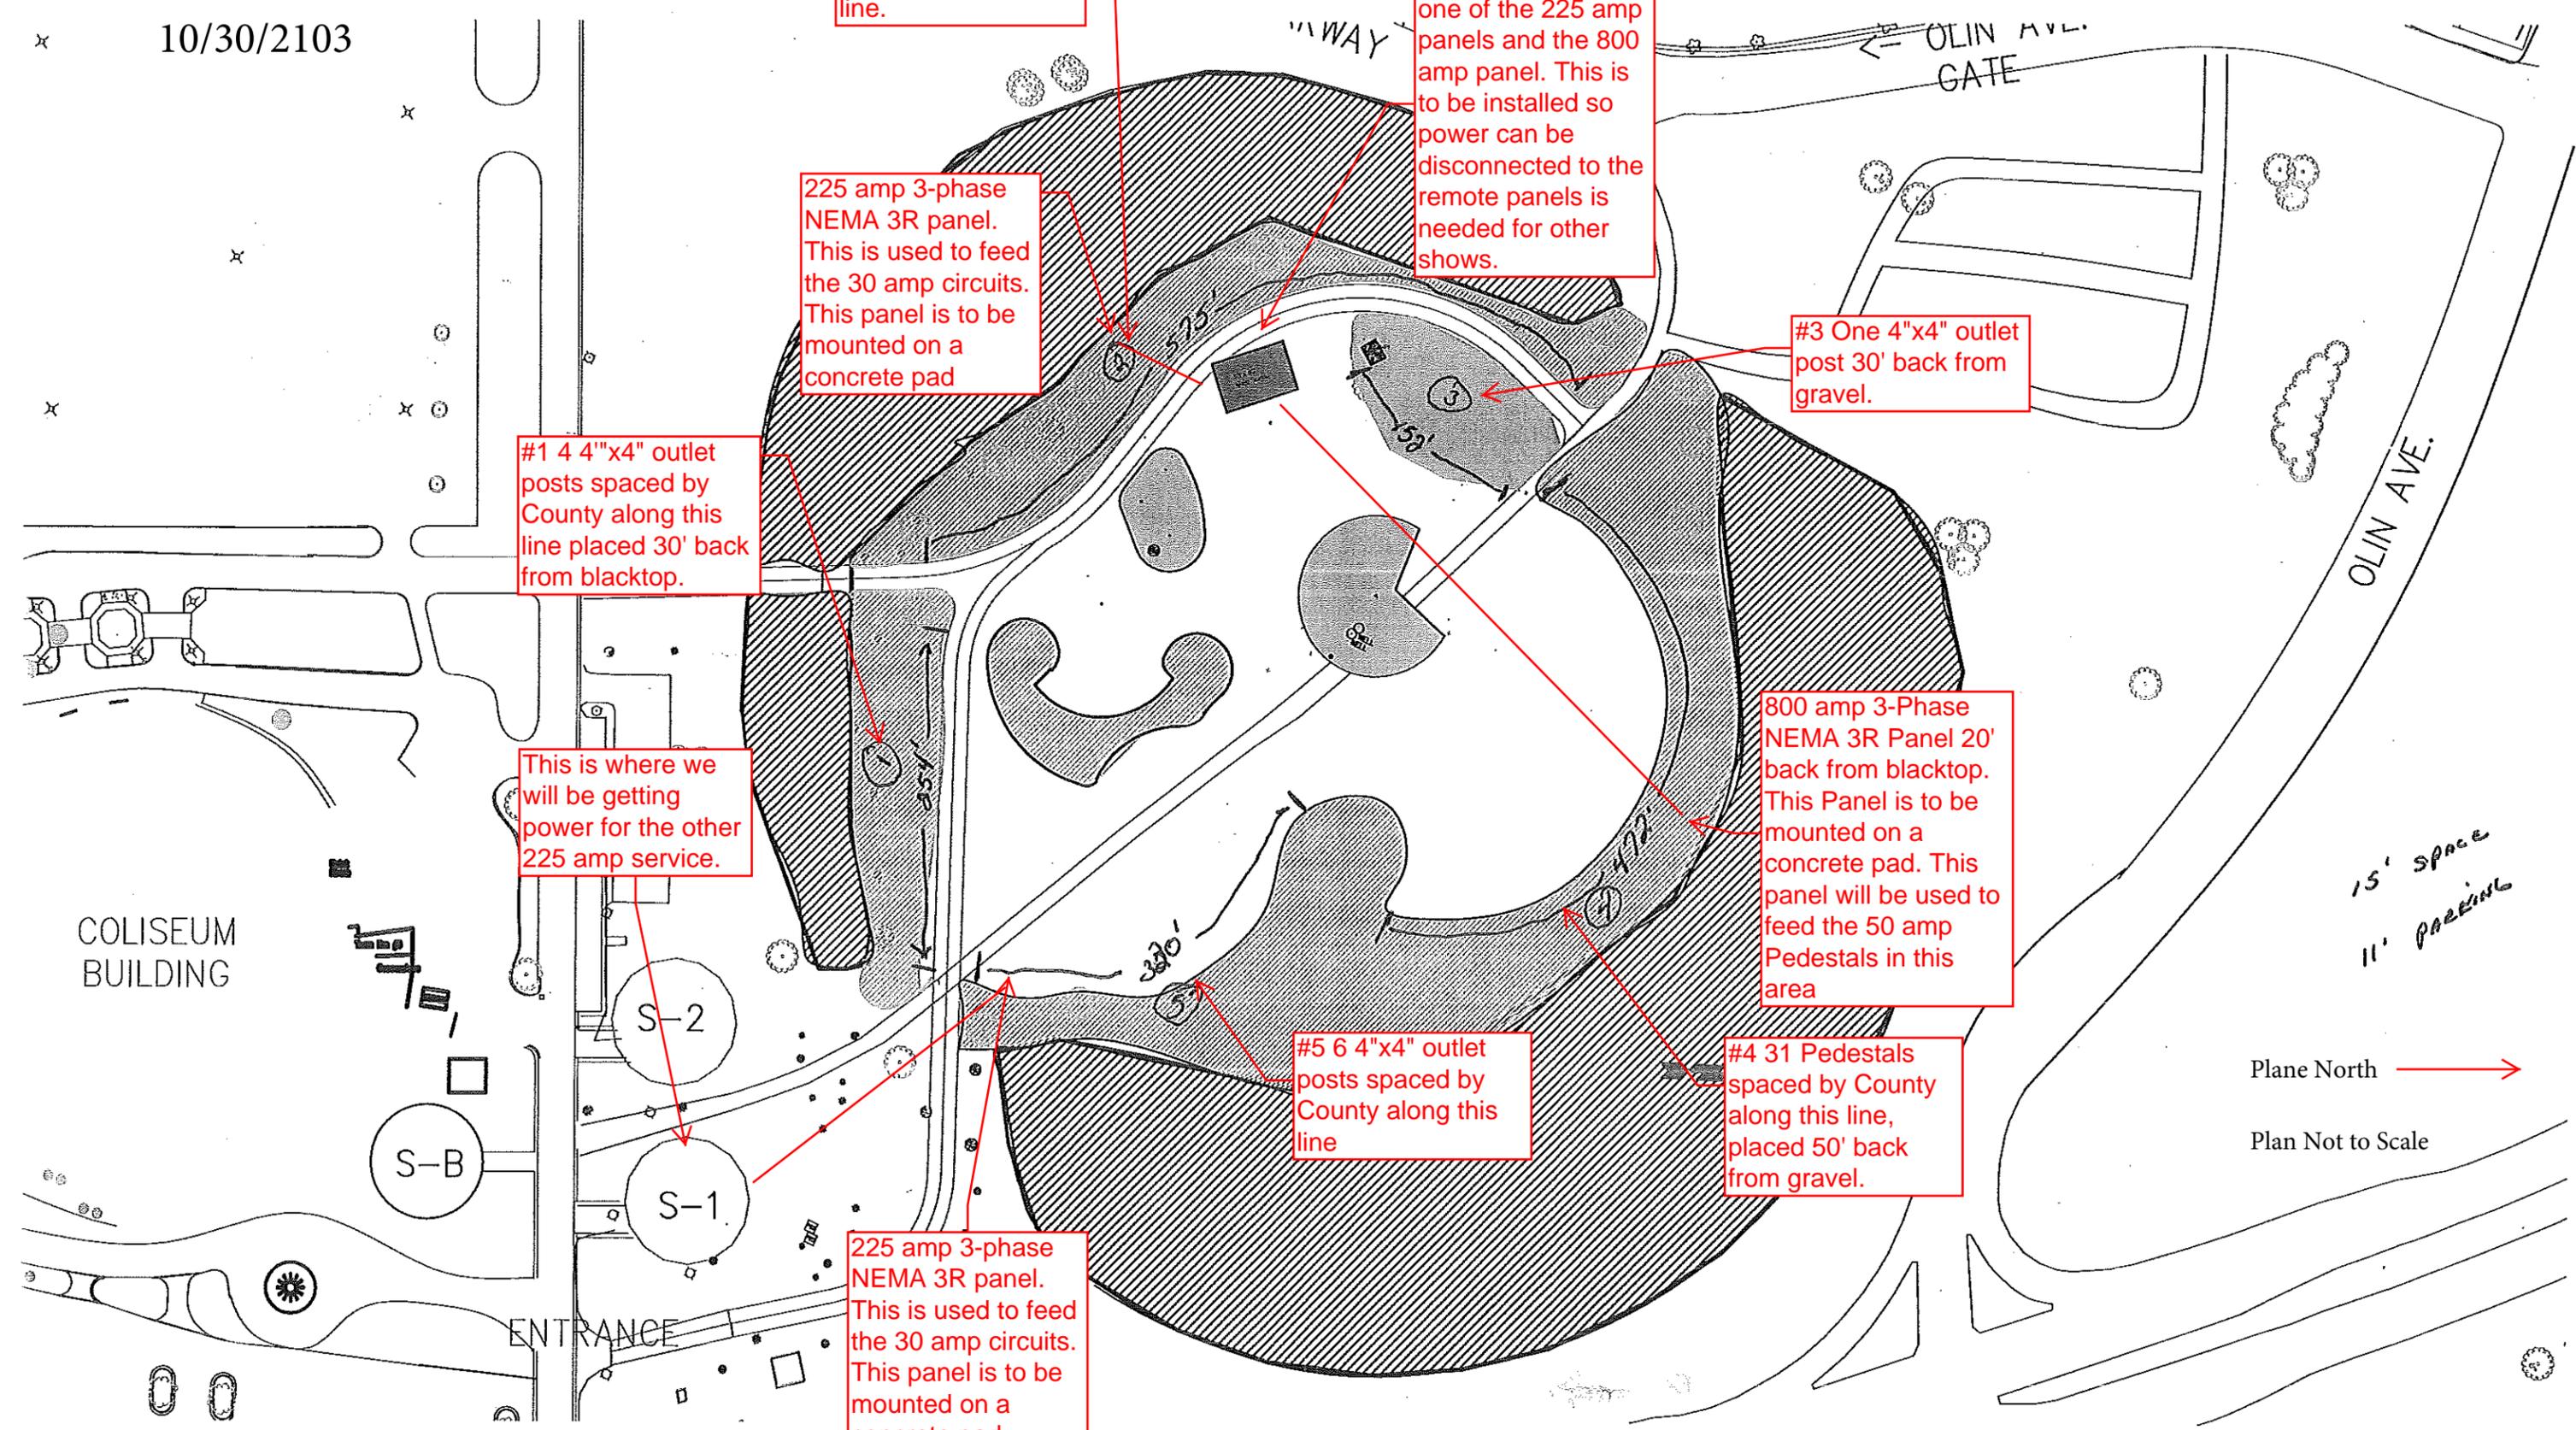

#2 10 4"x4" outlet posts spaced by County along this line.

1200 amp service that will be feeding one of the 225 amp panels and the 800 amp panel. This is to be installed so power can be disconnected to the remote panels is needed for other shows.

225 amp 3-phase NEMA 3R panel. This is used to feed the 30 amp circuits. This panel is to be mounted on a concrete pad

#3 One 4"x4" outlet post 30' back from gravel.

#1 4 4"x4" outlet posts spaced by County along this line placed 30' back from blacktop.

This is where we will be getting power for the other 225 amp service.

800 amp 3-Phase NEMA 3R Panel 20' back from blacktop. This Panel is to be mounted on a concrete pad. This panel will be used to feed the 50 amp Pedestals in this area

#5 6 4"x4" outlet posts spaced by County along this line

#4 31 Pedestals spaced by County along this line, placed 50' back from gravel.

225 amp 3-phase NEMA 3R panel. This is used to feed the 30 amp circuits. This panel is to be mounted on a concrete pad

Plane North →  
Plan Not to Scale