


### CONCRETE SLAB

1/4" = 1'-0"

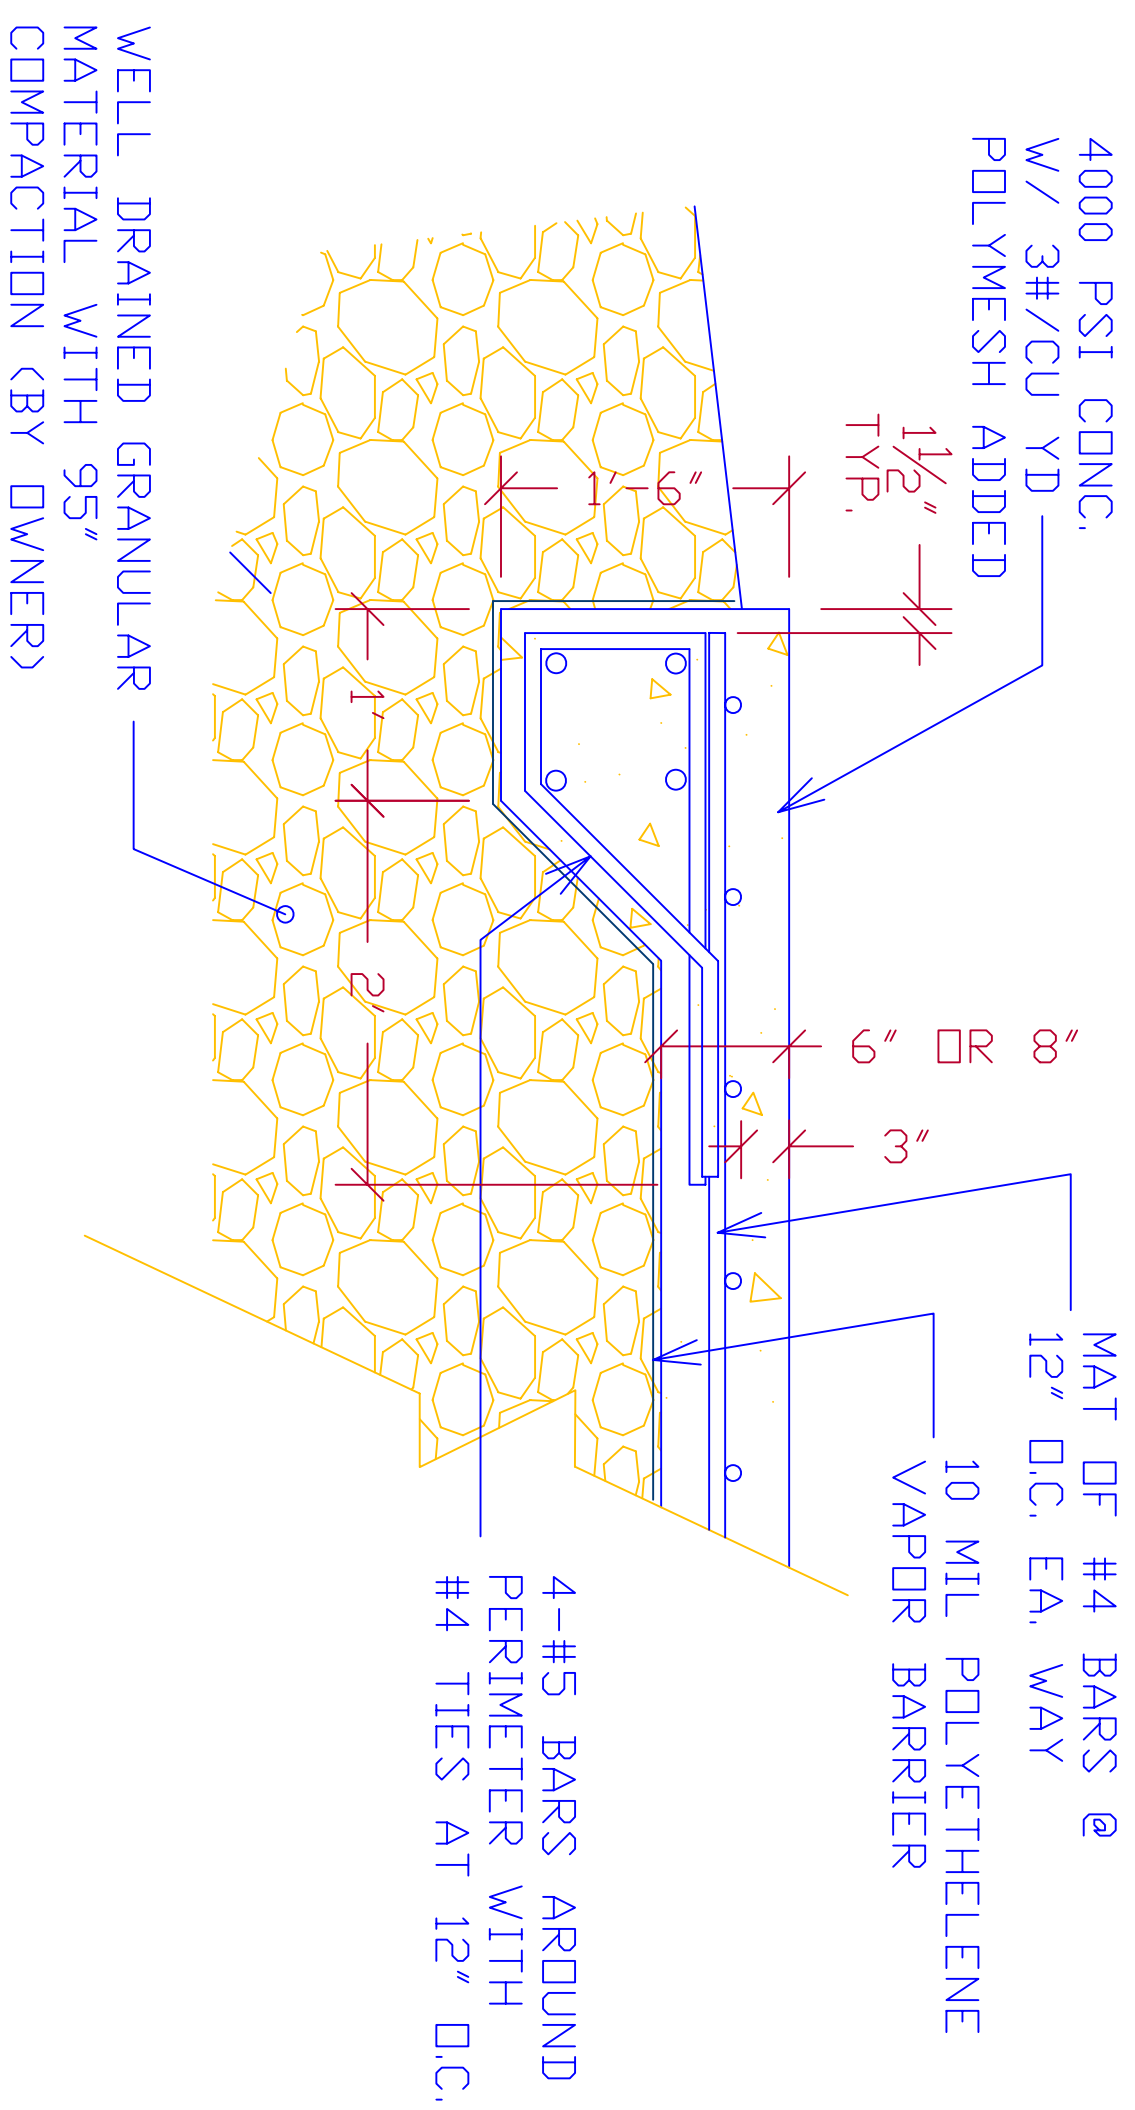

### SLAB DETAIL 1

1" = 1'-0"

- NOTES:**
- USE AIR ENTRAINED CEMENT FOR EXTERIOR CONDITIONS
  - CONCRETE TO HAVE 3'-4" SLUMP AND A SMOOTH TROWEL FINISH THEN WITH FINE HAIR BRUSH FINAL FINISH
  - COVER CONCRETE AND CURE FOR 5 DAYS MAINTAINING 40+ MIN. TEMPERATURE
  - ALL BARS TO BE A MINIMUM OF GRADE 60, LAPPED 16" AND SECURELY WIRE TIED
  - SEAL FINISHED CONCRETE WITH TWO COATS OF CURE 'N' SEAL
  - PLUMBING, ELECTRICAL WORK AND SUBGRADE PREPARATION BY OTHERS

GENERATOR SLAB CONSTRUCTION  
RODEFELD SITE NO.2  
7102 HWY. 12/18  
DANE COUNTY, WISCONSIN

DEPARTMENT OF PUBLIC WORKS  
DANE COUNTY WISCONSIN

Design By: MD	Drawn By: JRL	Approved By: JFS	Revisions
Bid No: 310001	Date: 1/8/10	Scale: AS NOTED	