



DEPT. OF
HIGHWAY &
CONSTRUCTION

1919 Alliant Energy Center Way
Madison, Wisconsin 53713
Office: 608/266-4018 ♦ Fax: 608/267-1533
Public Works Engineering Division
Public Works Solid Waste Division

ADDENDUM

June 22, 2016

ATTENTION ALL REQUEST FOR BID (RFB) HOLDERS

RFB NO. 315050 - ADDENDUM NO. 1

CNG GARAGE RETROFIT

BIDS DUE: TUESDAY, JUNE 28, 2016, 2:00 PM. DUE DATE AND TIME ARE NOT CHANGED BY THIS ADDENDUM.

This Addendum is issued to modify, explain or clarify the original Request for Bid (RFB) and is hereby made a part of the RFB. Please attach this Addendum to the RFB.

PLEASE MAKE THE FOLLOWING CHANGES:

1. Project Manual

Delete lines 25 through 28 on Page 1, Description of Work under Section 23 09 26 and substitute the following:

“Furnish and install a complete Single Zone Gas Detection System within the Dane County Public Safety Building Sub-Basement Parking Area Facility as described herein and as shown on the plans; to be wired, connected, and left in first class operating condition.”

2. Add Discharge Duct Detail Drawing (ME 102)

3. Changes to Parking Garage Floor Plan (ME 101)

ME101 Parking Floor Plan: At Exhaust Fan EF-1A delete ductwork shown from the outlet of EF-1A to the discharge at concrete retaining wall. Replace this ductwork with the duct as detailed in new detail BR-ME102 which is included in this addendum.

ME101 Parking Floor Plan: Between the new garage door and the door operator add Electrical Key Note 6.

ME101 Parking Floor Plan: the contractor shall provide a 12 inch long ½ inch EMT conduit through the wall at the location of the wireless cable is passing over the new garage door. Dane County will remove and relocate the cable through the conduit.

ME101 Parking Floor Plan: The location of the Control Room for the termination of the CNG alarm notification is on the basement floor one floor above the sub-basement parking garage between column lines X6 and X6.5 along column line XF. Exact location of the rise shall be field confirmed.

Mechanical Key Notes: Delete the keynote 12 and replace with “SEE NEW DETAIL BR-ME102 FOR REVISED EF-1A DISCHARGE.”

Mechanical Key Notes: Delete keynotes 35, 37 and 38.


Electrical Key Notes: Add Key Note 6: Fluorescent light fixture in the path of the overhead door shall be relocated beyond door in the open position the by the Contractor

If any additional information about this Addendum is needed, please call Eric Urtes at 608/266-4798, urtes.eric@countyofdane.com.

Sincerely,
Eric Urtes
AIA-Project Manager

Enclosures:
Discharge Duct Detail Drawing (ME102)

H:\Shared\ENGINEERING DIVISION\Eric Urtes\315050 - Public Safety Building - CNG Retrofit\03 - Addendum\Addendum 1\Addendum 1 (FINAL).docx

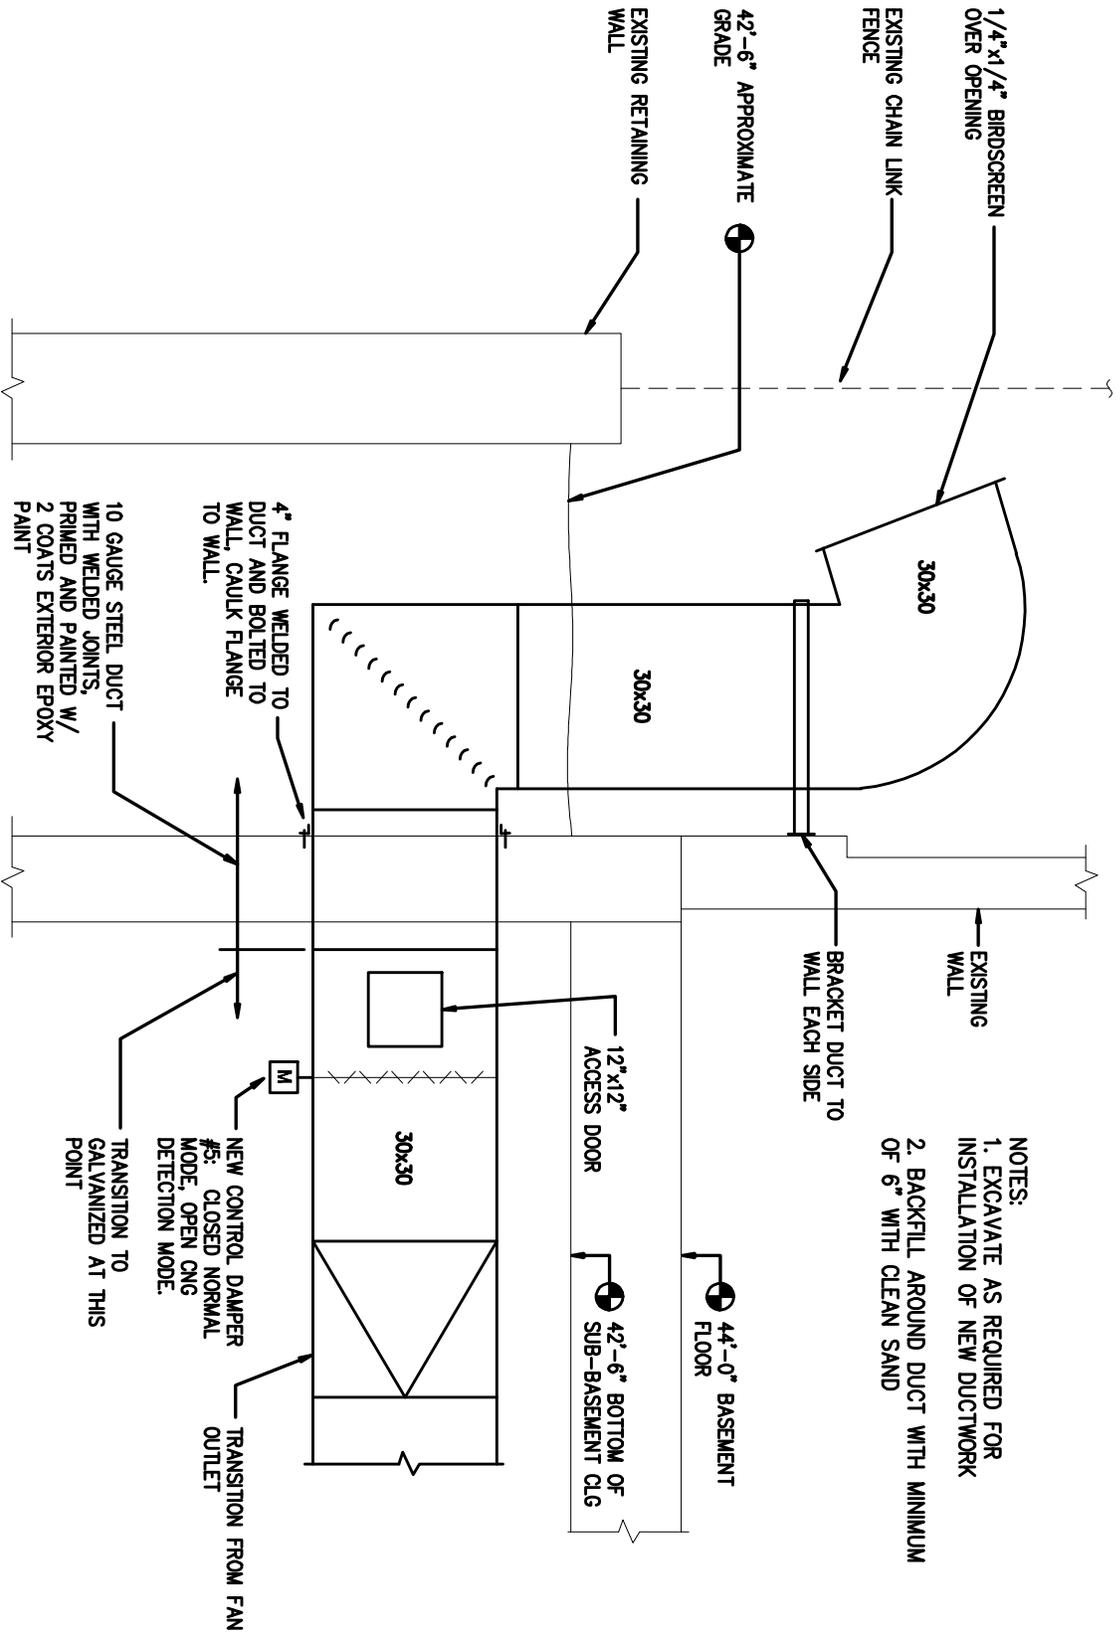

DANE COUNTY PUBLIC SAFETY BUILDING
 CNG PARKING GARAGE RETROFIT
 ADDENDUM #1

DISCHARGE DUCT

Addendum 1

BR
 ME102

NOT TO SCALE